


Figure 2: minimum circulation airflow

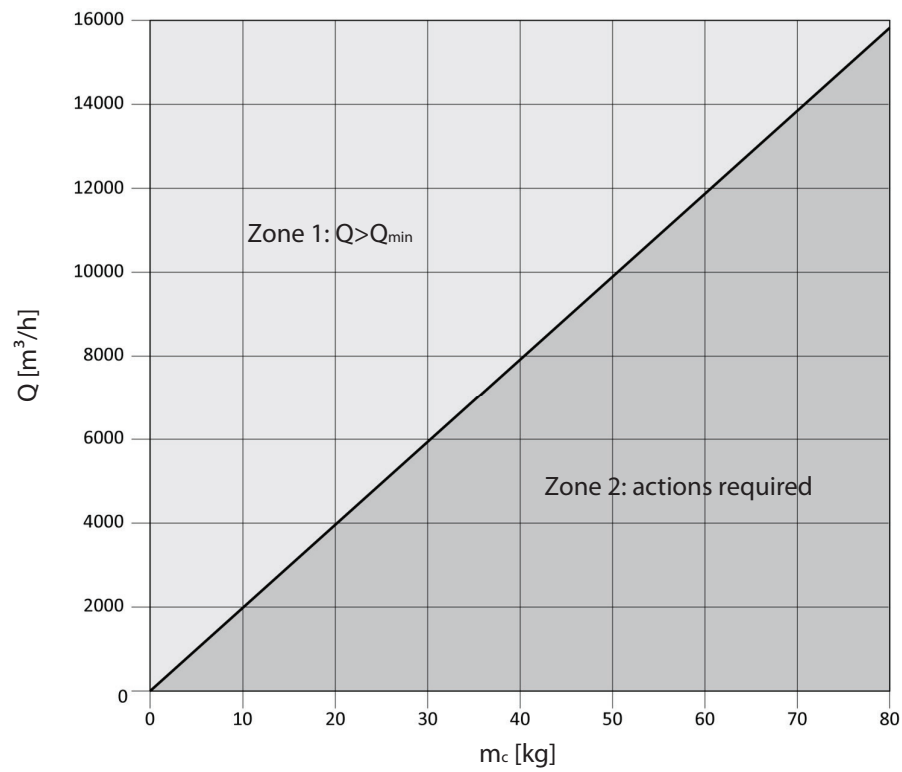

$Q_{min} = \frac{60 \cdot m_c}{LFL}$ (Equation 2)	
Symbols	Description
Q [m³/h]	Circulation airflow rate
Q_{min}	Minimum circulation airflow rate
LFL	Lower flammability limit = 0.307 kg/m³ for R32
m_c	Total refrigerant charge in the system