
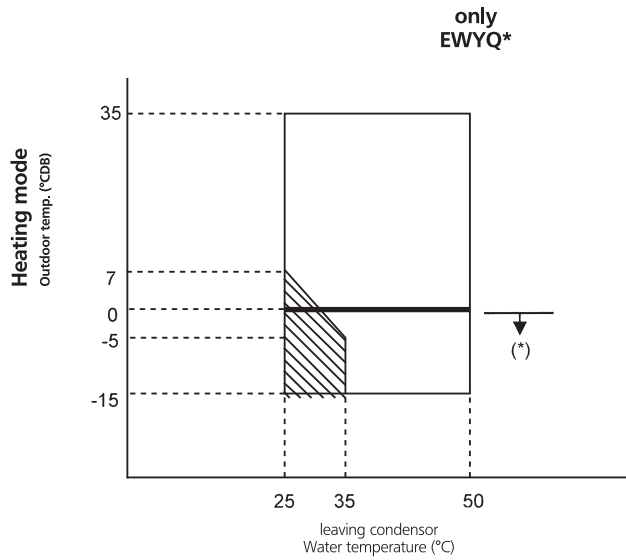


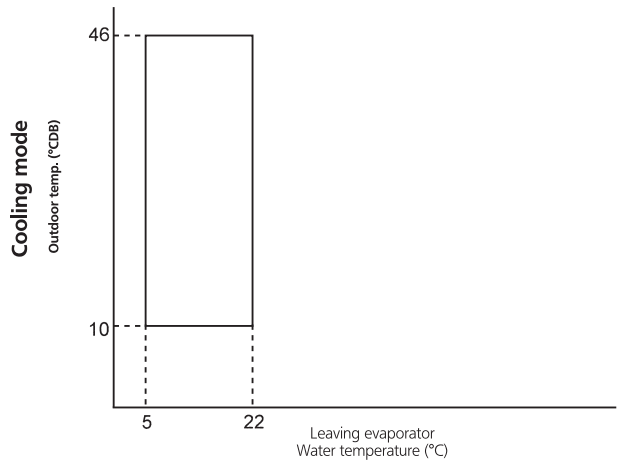

- No heatpump operation.
 - In this area the minimum watervolume must be increased to 40l
- (*) In case ambient temperatures below 0°C are likely to happen, we recommend to use
* Glycol (for more information, see installation manual),
or
* OP10 (Insulation+ heatertape around the waterpiping).