

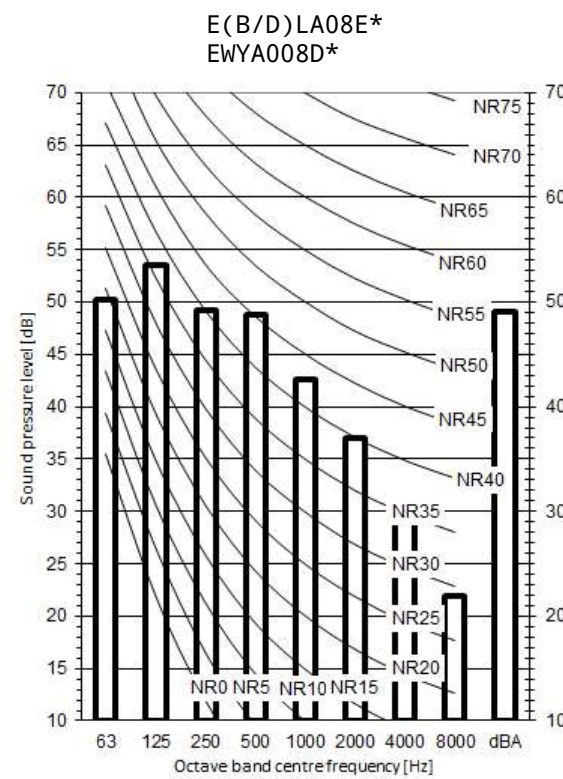
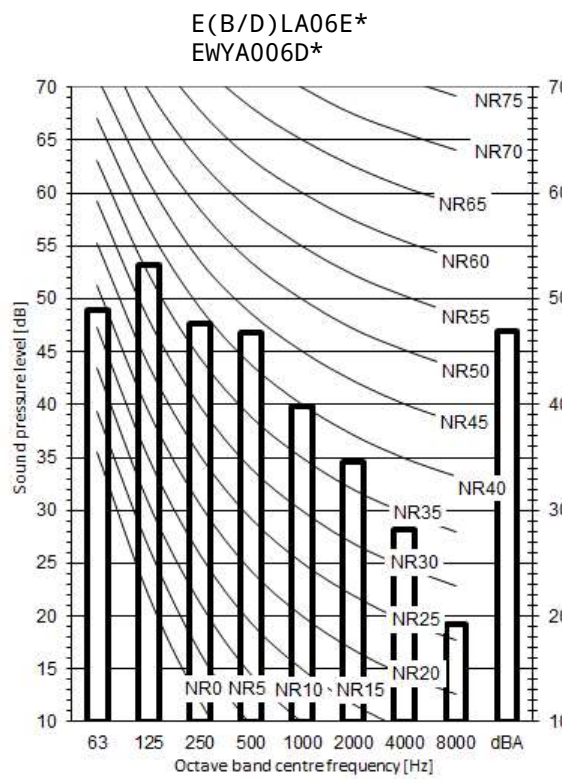


Heating

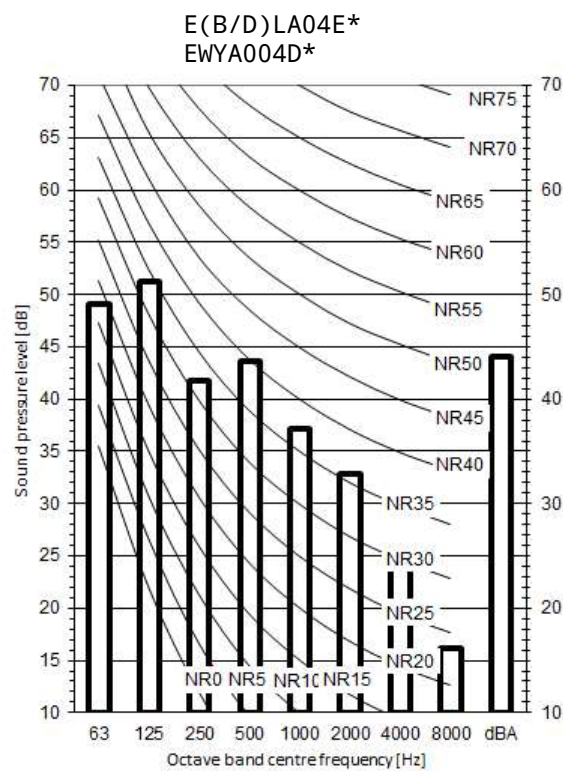

Notes

- 1.Data is valid at free field condition.
Measured in a semi-anechoic chamber
- 2.Data is valid at nominal operation condition.
- 3.dBA = A-weighted sound pressure level (A scale according to IEC).
- 4.Reference acoustic pressure 0 dB = 20 μ Pa
- 5.If the sound is measured under actual installation conditions, the measured value will be higher due to environmental noise and sound reflections.

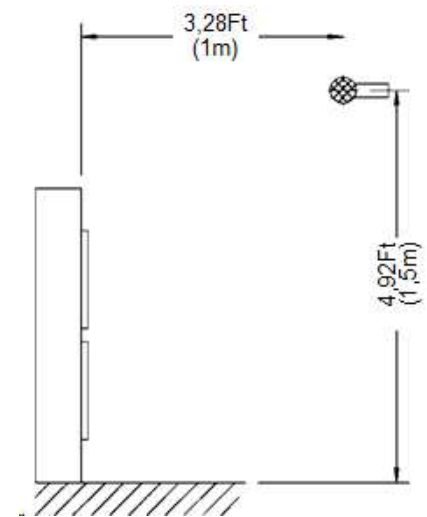

Measuring location (discharge side)