



Cooling

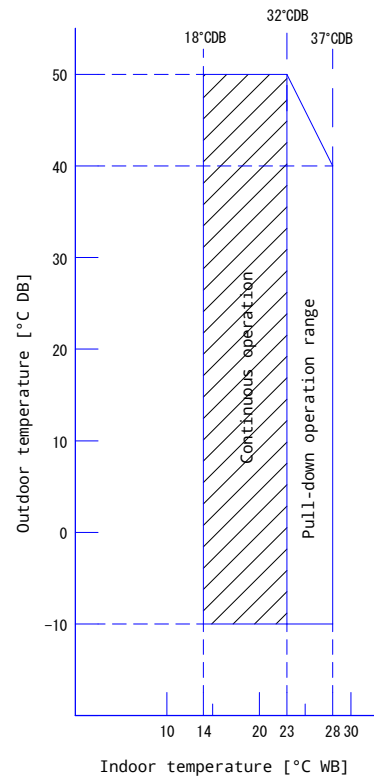

Heating

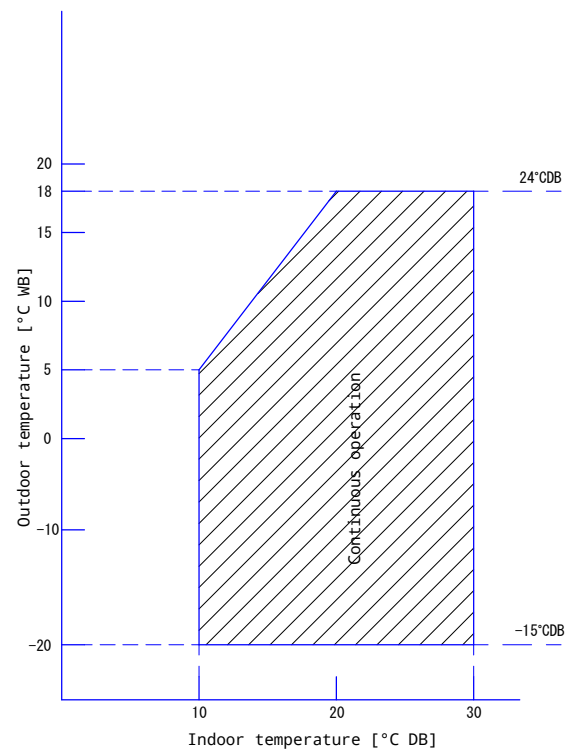

- Notes
- 1. The graph is based on the following conditions.
 - Corresponding refrigerant piping length: 5 m
 - Level difference: 0 m
 - Air flow rate: High