


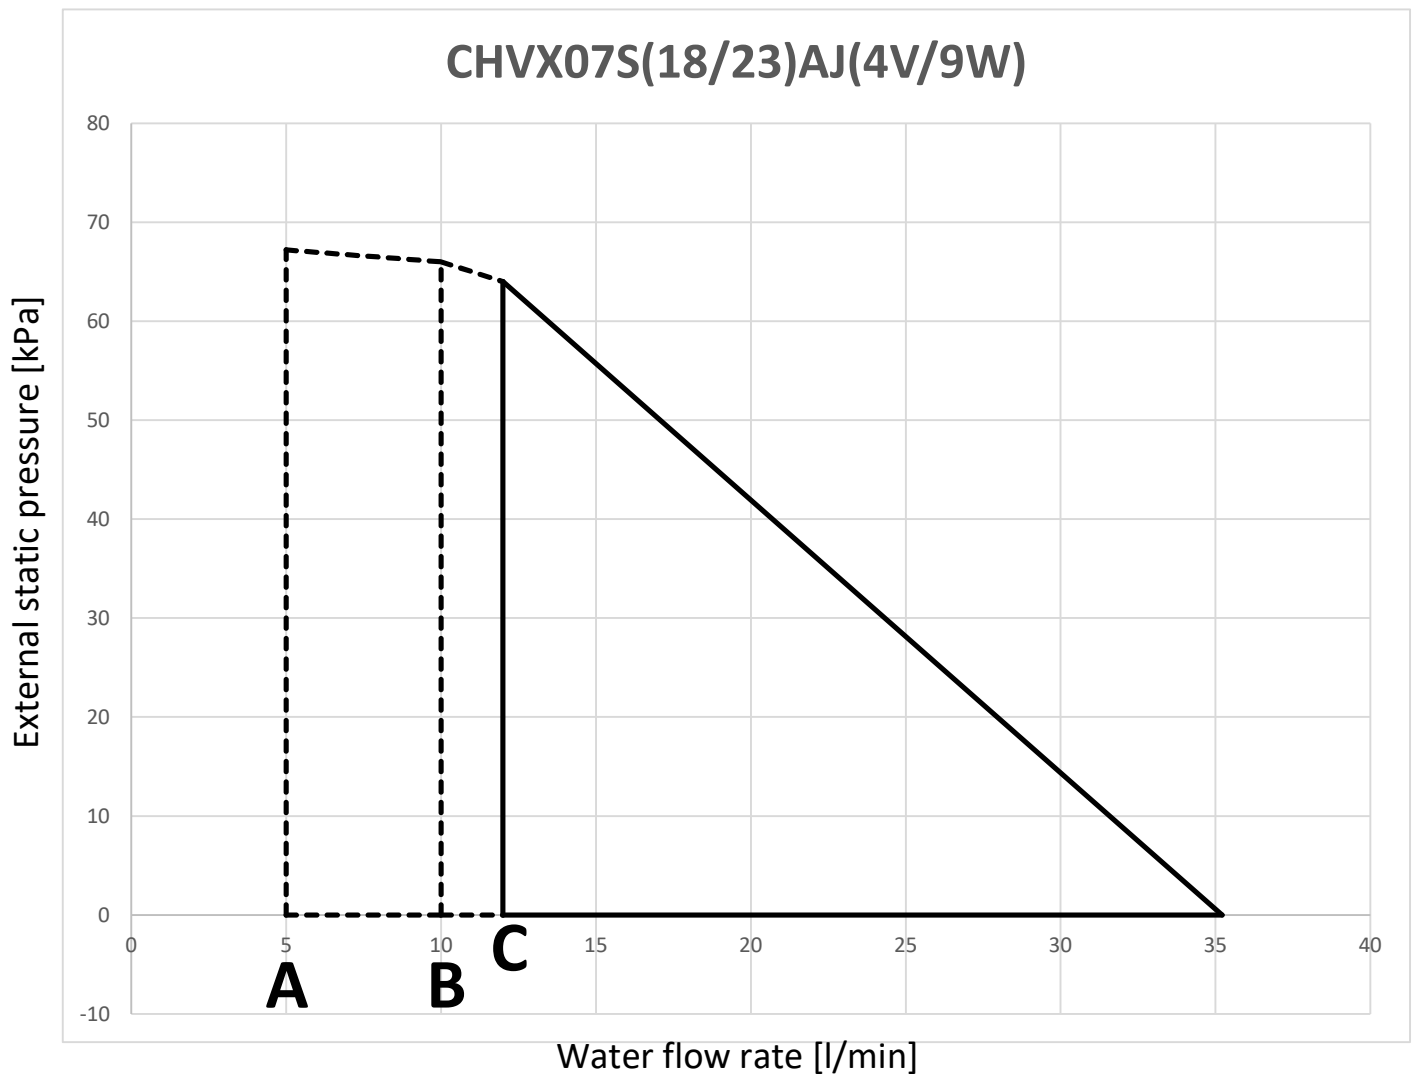

- A Minimum water flow rate during normal operation
- B Minimum water flow rate during cooling operation
- C Minimum water flow rate during defrost/backup heater operation

#### Notes

1. Selecting a flow outside the operating area can damage the unit or cause the unit to malfunction.  
See also the minimum and maximum allowed water flow range in the technical specifications.
2. Make sure water quality complies with EU Directive ·2020/2184·