


E(B-D) LQ011-016CW1_CV3

Electrical connection diagram Daikin Monobloc GQI Liquid Injection

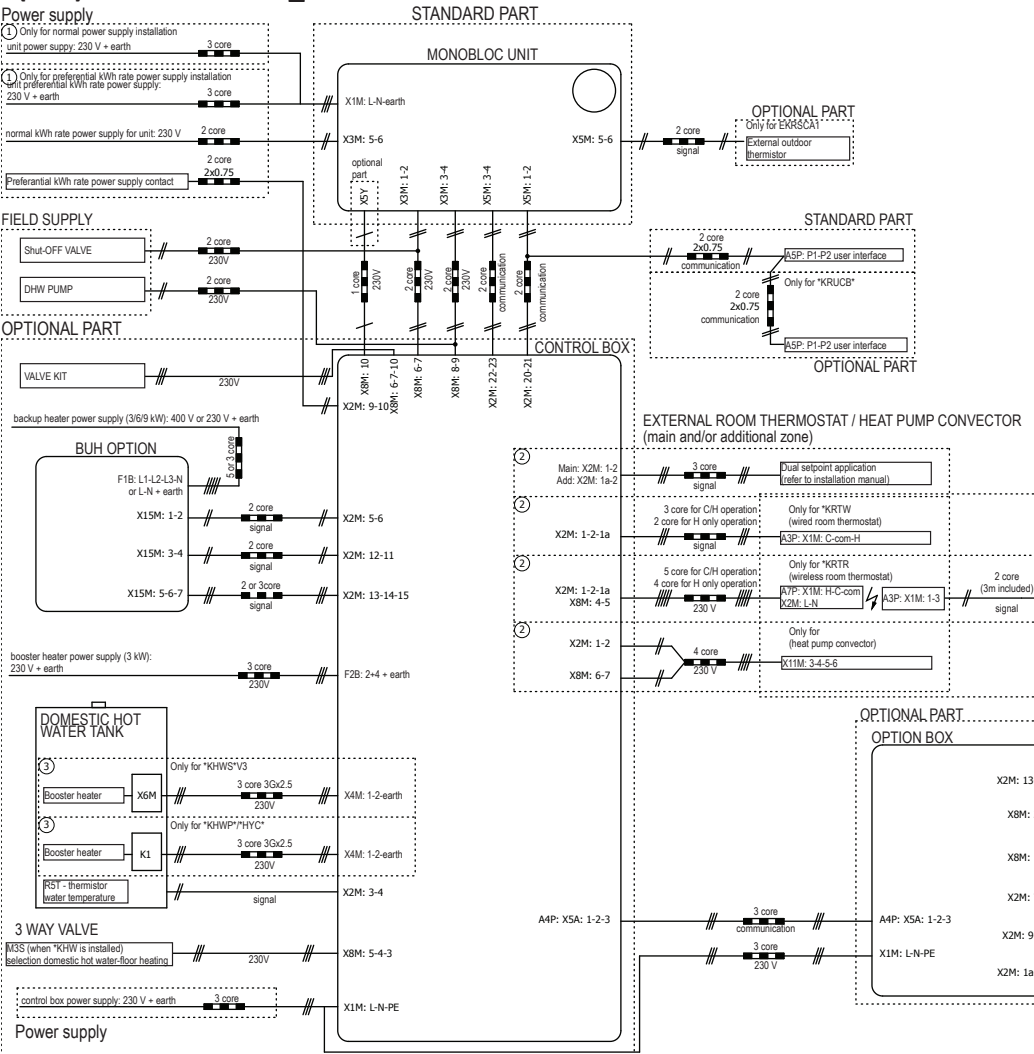

TYPICAL CONFIGURATION		
		
		2 low voltage wires
		Standard: 4 low voltage wires Optional: 4 high voltage wires
		Only for EDLQ* Standard: 4 low voltage wires Optional: 4 high voltage wires Inside: 6 or 7 wires to BUH
		Only for EBLQ* Standard: 4 low voltage wires Optional: 5 high voltage wires Inside: 6 or 7 wires to BUH Valve kit: 3 wires

NOTES

- In case of signal cable: keep minimum distance to power cables > 5 cm
- Available heaters: see combination table