


Heat-up times ·GBS (1)·

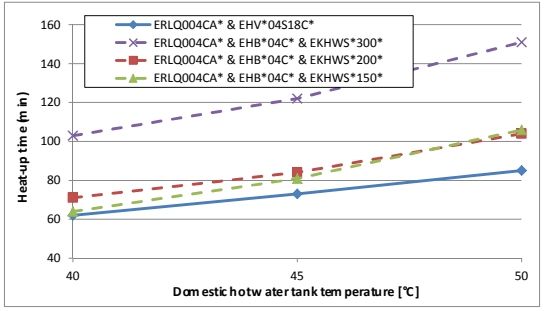

	Heat-up time domestic hot water tank until 45°C	
	ERLQ004CA*	ERLQ00(6/8)CA*
EHV*04S18C*	73	N/A
EHV*08S18C*	N/A	55
EHV*08S26C*	N/A	77
	ERLQ004CA* & EHB*04C*	ERLQ00(6/8)CA* & EHB*08C*
EKHWS*150*	81	73
EKHWS*200*	84	68
EKHWS*300*	122	99

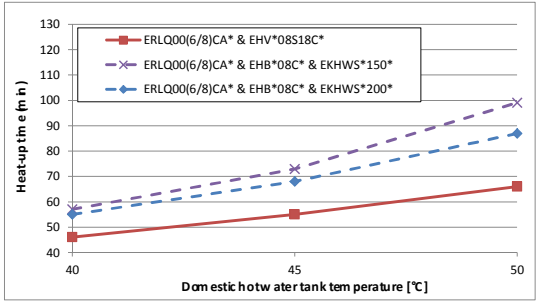

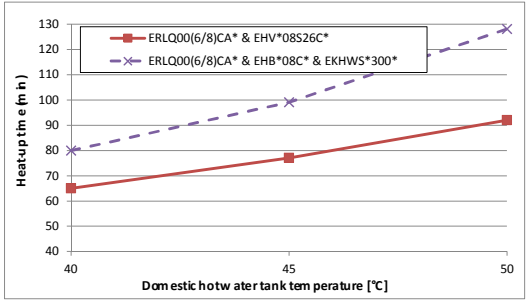

Notes

1. Time the indoor unit (**heat pump only operation**) requires to heat up the domestic hot water tank from 10°C to the indicated temperature.
   See the operation range for maximum domestic hot water tank temperature during heat pump only operation.