

EHBH-CBV

1-phase B series
11~16 kW class

Backup heater

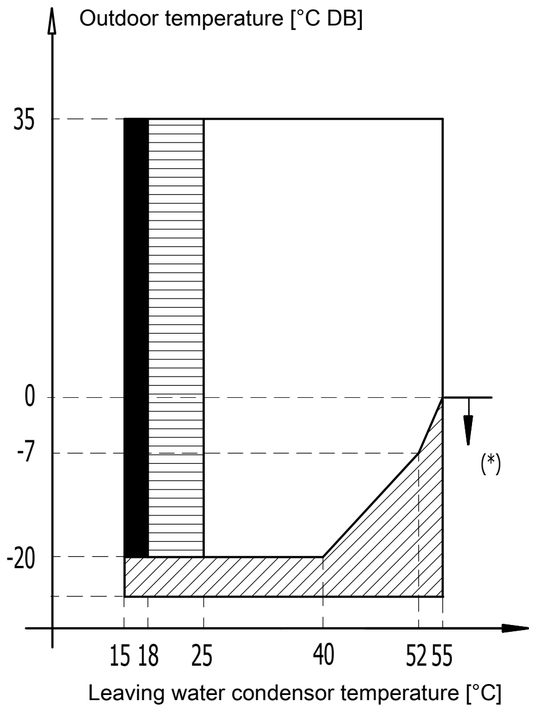

Backup heater

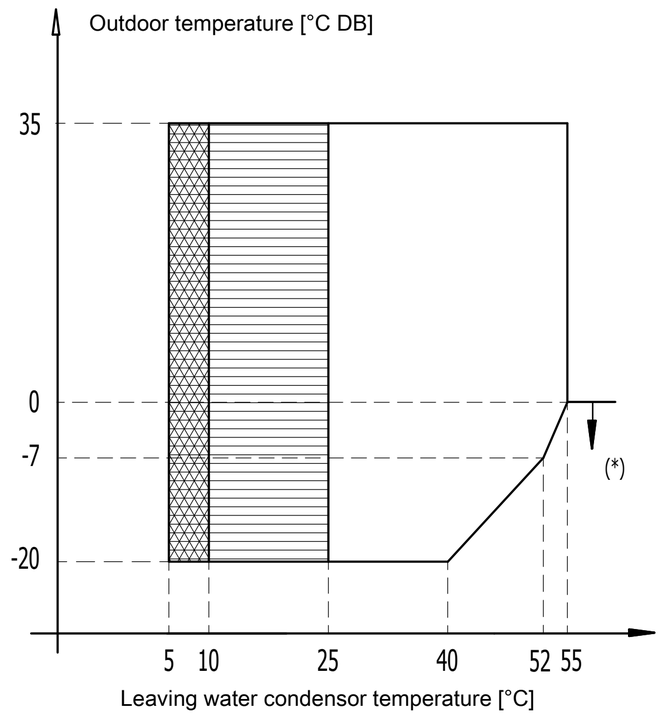

Legend

Backup heater only operation
No outdoor unit operation

Outdoor unit operation if setpoint ≥ 25°C

Circulation pump

Outdoor unit operation + backup heater operation

Remark

In restricted power supply mode, the outdoor unit, anti-legionella heater and backup heater can only operate separately.

(*) *RLQ units include special equipment (insulation, heater sheet, ...) to ensure proper operation in areas with low ambient temperatures and high humidity conditions.
In such conditions, the *RHQ models may experience problems with severe ice buildup on the air-cooled coil.
If such conditions are expected, the *RLQ must be installed instead.
These models contain countermeasures (insulation, heater sheet, ...) to prevent freeze-up.