
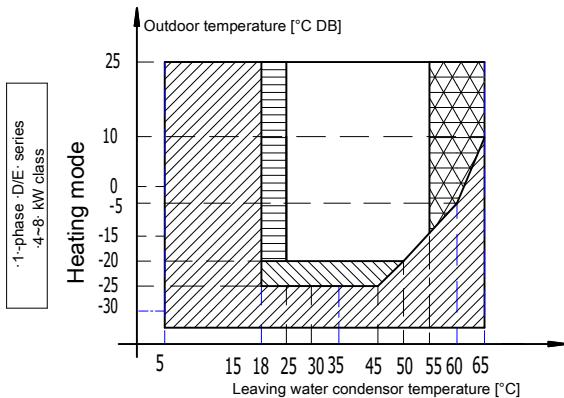


**EHSH-E**  
**EHSHB-E**  
**EHSX-E**  
**EHSXB-E**

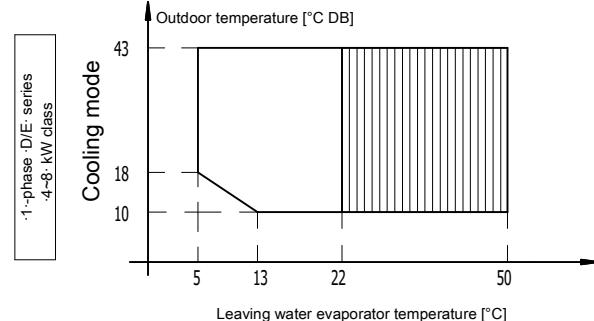

#### Legend

- Backup heater only operation  
No outdoor unit operation
- Outdoor unit operation if setpoint  $\geq -25^{\circ}\text{C}$ :
- Operation of outdoor unit possible, but with possible capacity reduction.  
If the outdoor temperature  $< -25^{\circ}\text{C}$ , the outdoor unit will stop.  
Indoor unit and backup heater operation will continue.
- Pull-down area
- Outdoor unit operation if setpoint  $> -55^{\circ}\text{C}$  and  $\Delta T = -10^{\circ}\text{C}$  ( $\Delta T = \text{outlet temperature} - \text{inlet temperature}$ )

**Indoor**  
**-D/E(A/F/G/J) series Standard**

#### Remark

In restricted power supply mode, the outdoor unit, booster heater and backup heater can only operate separately.

#### Warning

In areas with low ambient temperatures and high humidity, or in areas with heavy snowfall, remove the suction grille to ensure proper operation.

Non-exhaustive list of areas: Austria, Czech Republic, Denmark, Estonia, Finland, Germany, Hungary, Latvia, Lithuania, Norway, Poland, Romania, Serbia, Slovakia, Sweden, ...