


**NOTES to go through before starting the unit**

- X1M : Main terminal
- X2M : Field wiring terminal for AC
- X5M : Field wiring terminal for DC
- X6M : BUH Power supply terminal
- X10M : Smartgrid terminal
- ..... : Earth wiring
- : Field supply
- ① : Several wiring possibilities

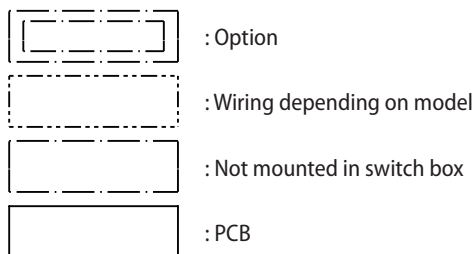


**NOTES**

1. Connection point of the power supply for the BUH should be foreseen outside the unit.

- Backup heater power supply
  - 3V (1N~, 230V, 3kW)
  - 6T1 (3~, 230V, 6kW)
  - 6V3 (1N~, 230V, 6kW)
  - 6WN/9WN (3N~, 400V, 6/9kW)
- User installed options:
  - LAN adapter
  - Remote user interface
  - Ext. indoor thermistor
  - Ext. outdoor thermistor
  - Digital I/O PCB
  - Demand PCB
  - Safety thermostat
  - Smartgrid kit
  - WLAN adapter module
  - WLAN cartridge
- Main LWT:
  - ON/OFF thermostat (wired)
  - ON/OFF thermostat (wireless)
    - Ext. thermistor
  - Heat pump convector
- Add LWT:
  - ON/OFF thermostat (wired)
  - ON/OFF thermostat (wireless)
    - Ext. thermistor
  - Heat pump convector

**POSITION IN SWITCH BOX**

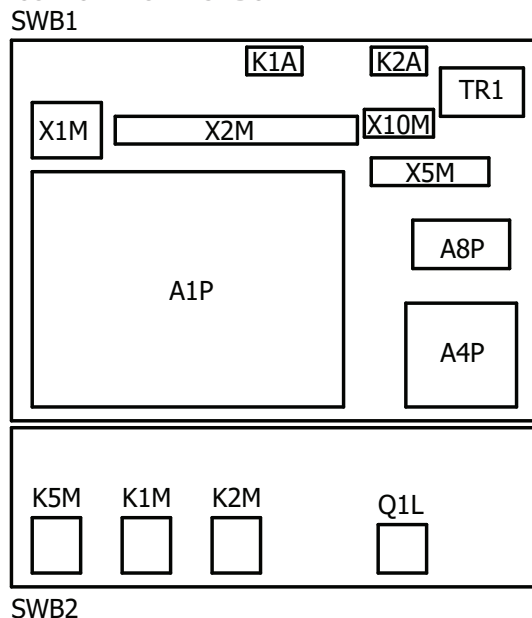

**LEGEND**

Part n°	Description	Part n°	Description
A1P	main PCB	P1M	MMI display
A2P	* ON/OFF thermostat (PC=power circuit)	PC (A15P)	* power circuit
A3P	* heat pump convector	PHC1 (A4P)	* optocoupler input circuit
A4P	* digital I/O PCB	Q1L	thermal protector backup heater
A8P	* demand PCB	Q4L	# safety thermostat
A9P	status indicator	Q*DI	# earth leakage circuit breaker
A11P	MMI main PCB	R1H (A2P)	* humidity sensor
A13P	* LAN adapter	R1T (A1P)	outlet water heat exchanger thermistor
A14P	* user interface PCB	R1T (A2P)	* ambient sensor ON/OFF thermostat
A15P	* receiver PCB (wireless ON/OFF thermostat)	R1T (A14P)	* ambient sensor user interface
A20P	* WLAN module	R2T (A1P)	outlet backup heater thermistor
B2L	flow sensor	R2T (A2P)	* external sensor (floor or ambient)
B1PR	refrigerant pressure sensor	R3T	refrigerant liquid side thermistor
B1PW	water pressure sensor	R4T	inlet water thermistor
CN* (A4P)	* connector	R5T, R8T	domestic hot water thermistor
DS1 (A8P)	* dipswitch	R6T	* external indoor or outdoor ambient thermistor
E1H	backup heater element (1 kW)	S1S	# preferential kWh rate PS contact
E2H	backup heater element (2 kW)	S2S	# electrical meter pulse input 1
E*P (A9P)	indication LED	S3S	# electrical meter pulse input 2
F1B	# overcurrent fuse backup heater	S4S	# smart grid feed-in
F1T	thermal fuse backup heater	S6S-S9S	* digital power limitation inputs
F1U, F2U (A4P)	* fuse 5 A 250 V for digital I/O PCB	S10S-S11S	# low voltage smartgrid contact
FU1 (A1P)	fuse T 6.3 A 250 V for PCB	SS1 (A4P)	* selector switch
K1A, K2A	* high voltage smartgrid relay	SW1~2 (A11P)	turn buttons
K1M, K2M	contactor backup heater	SW3~5 (A11P)	push button
K5M	safety contactor BUH	TR1	power supply transformer
K*R (A1P-A4P)	relay on PCB	X6M	# BUH power supply terminal strip
M1P	main supply pump	X10M	* smartgrid power supply terminal strip
M2P	# domestic hot water pump	X*, X*A, X*H*, X*Y	connector
M2S	# 2 way valve for cooling mode	X*M	terminal strip
M3S	3 way valve for spaceheating/ domestic hot water		

\* : optional

# : field supply