## EHV(H/X)-CB

### Heat-up times GQI (1)

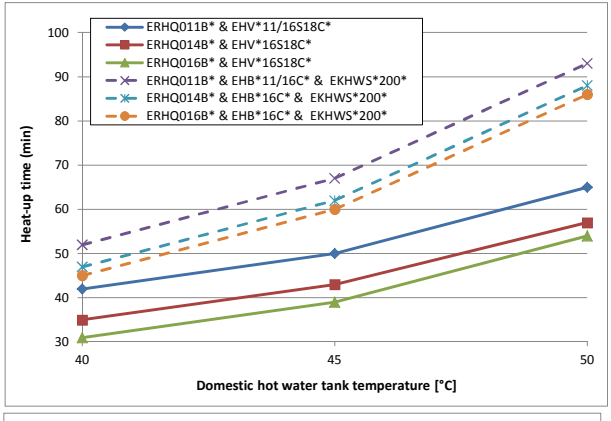


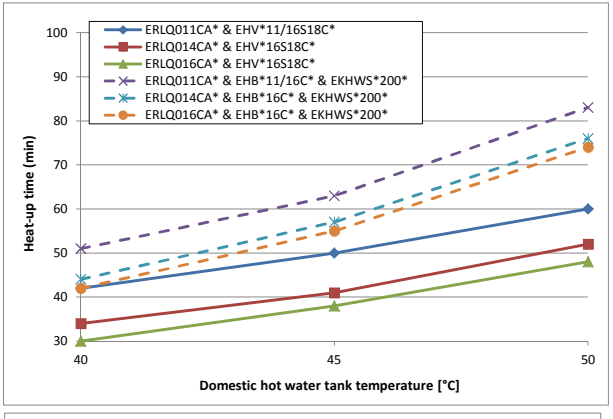


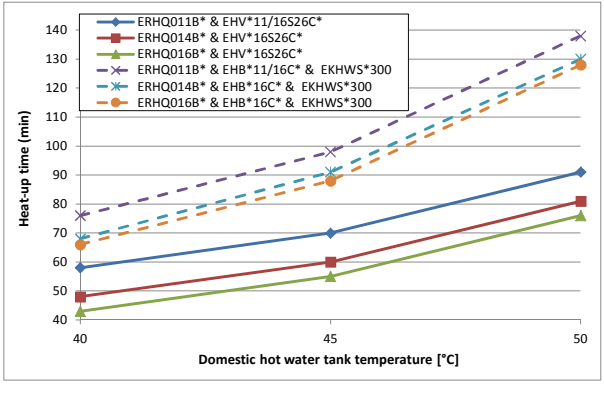


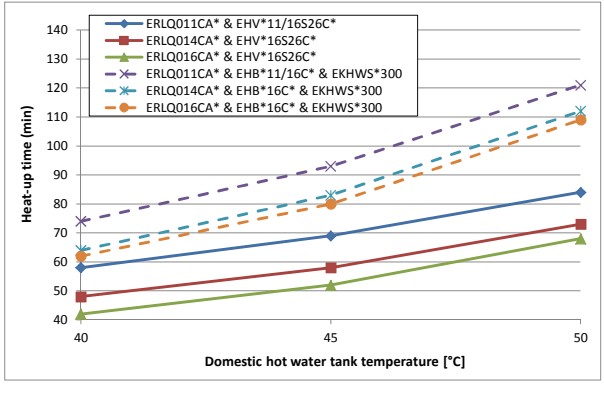


| Heat-up time domestic hot water tank until 45°C | | |
|---|---|---|
| | | |
| | | ERLQ016CA* |
| EHV*16S18C* | | 38 |
| EHV*16S26C* | | 52 |
| | | |
| | | ERLQ016CA* & EHB*16C* |
| EKHWS*150* | | 69 |
| EKHWS*200* | | 55 |
| EKHWS*300* | | 80 |

Notes

1. Time the indoor unit (heat pump only operation) requires to heat up the domestic hot water tank from 10°C to the indicated temperature.
   See the operation range for maximum domestic hot water tank temperature during heat pump only operation.