EKHVMYD-AB

Electrical connection diagram Altherma

For more details please check unit wiring diagram

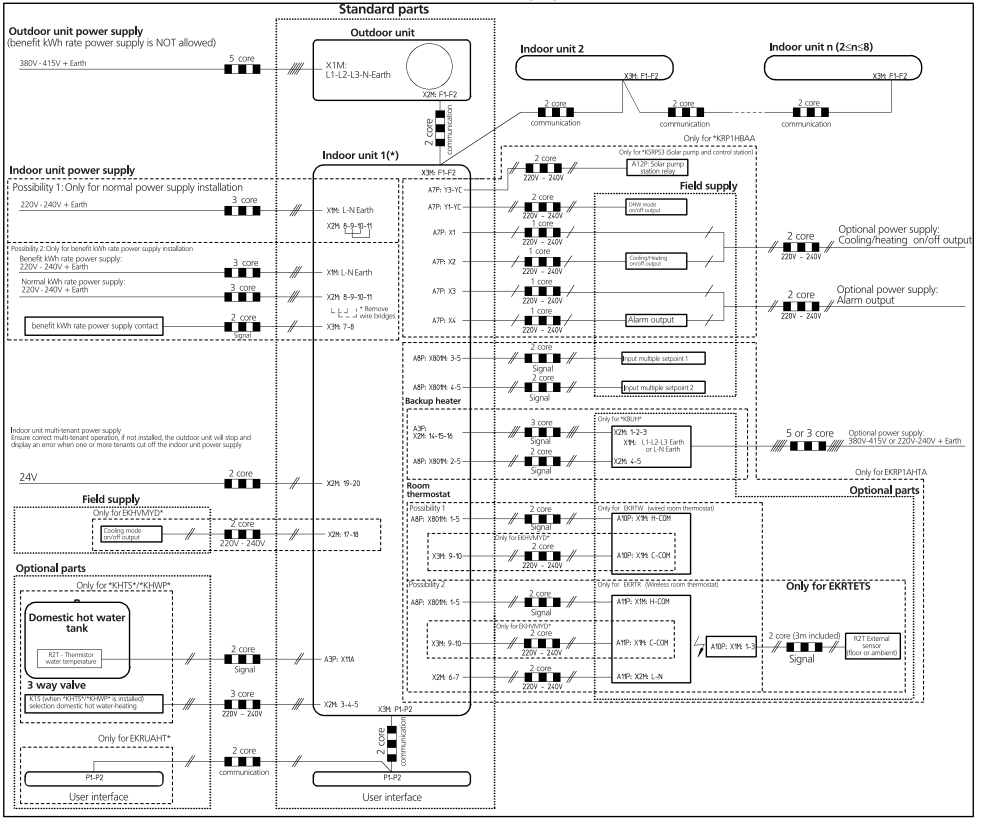

Notes:

1. In case of signal cable or communication cable. Keep minimum distance to power cables > 25mm
2. In this example unit 1 is a 50 or 80 class. In case unit 1 is a 011/014/016 class, refer to the connection diagram of this unit.