



EBLQ011-016BB6V3


**E(D/B)(H/L)Q011*
COOLING**

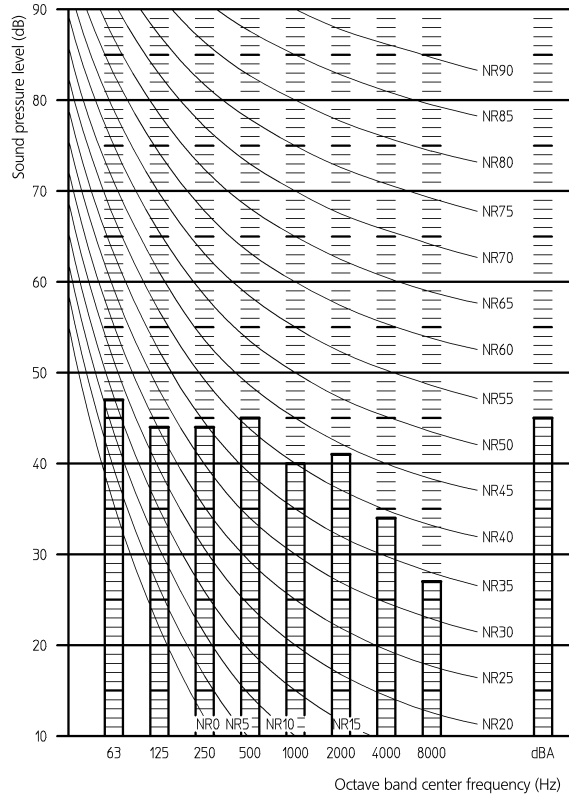

**E(D/B)(H/L)Q014*
COOLING**

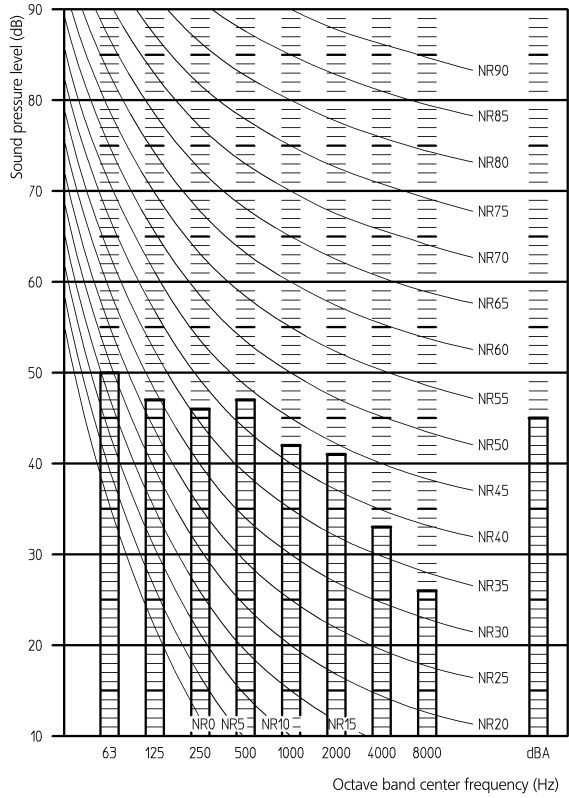


**E(D/B)(H/L)Q016*
COOLING**

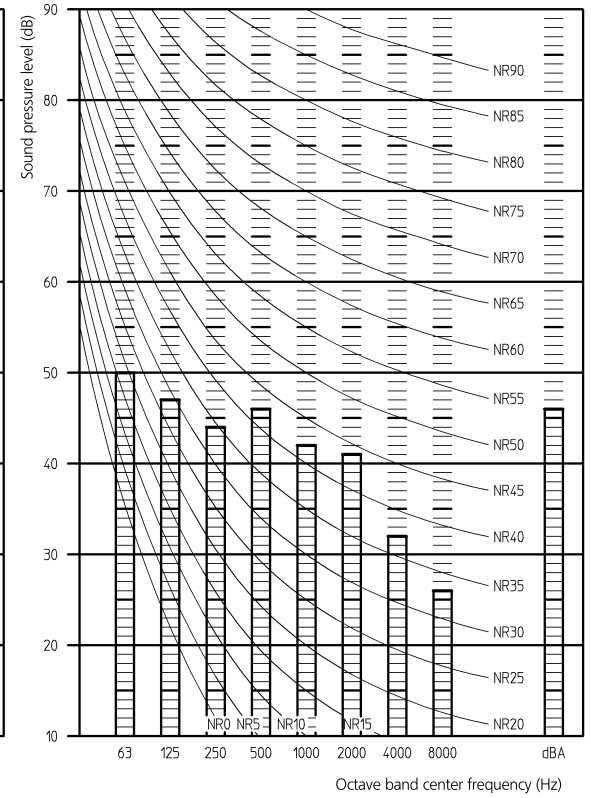

Notes:

- 1 Data is valid at free field condition (measured in a semi-anchoic room)
- 2 dBA = A-weighted sound power level (A-scale according to IEC)
- 3 Reference acoustic pressure 0dB = 20μPa
- 4 If sound is measured under actual installation conditions, the measured value will be higher due to environmental noise and sound reflections.

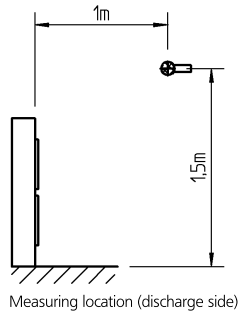

Measuring location (discharge side)