



**EBLQ011-016BB6V3**


**E(D/B)(H/L)Q011\*  
HEATING**

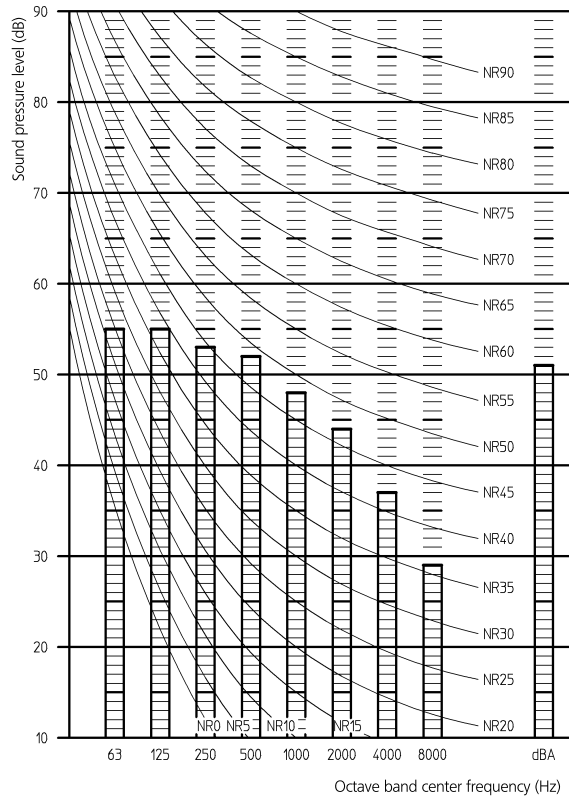

**E(D/B)(H/L)Q014\*  
HEATING**

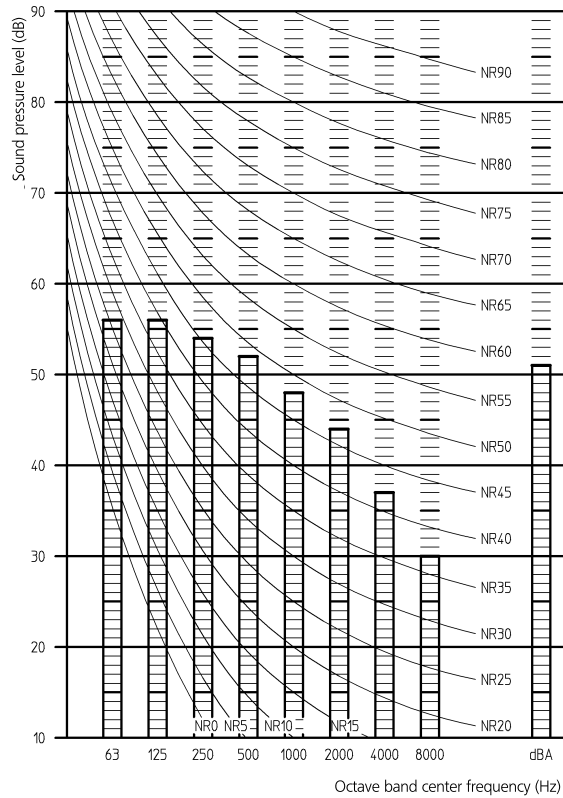


**E(D/B)(H/L)Q016\*  
HEATING**

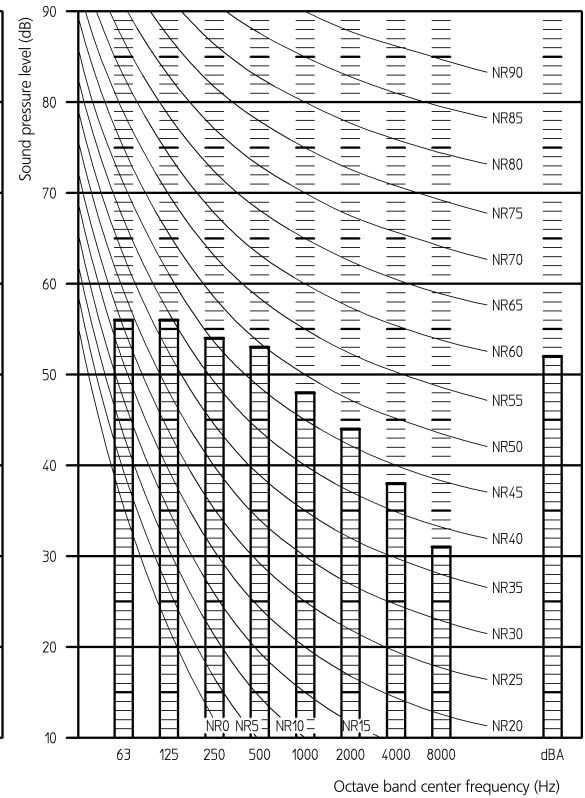

**Notes:**

- 1 Data is valid at free field condition (measured in a semi-anchoic room)
- 2 dBA = A-weighted sound power level (A-scale according to IEC)
- 3 Reference acoustic pressure 0dB = 20µPa
- 4 If sound is measured under actual installation conditions, the measured value will be higher due to environmental noise and sound reflections.



Measuring location (discharge side)