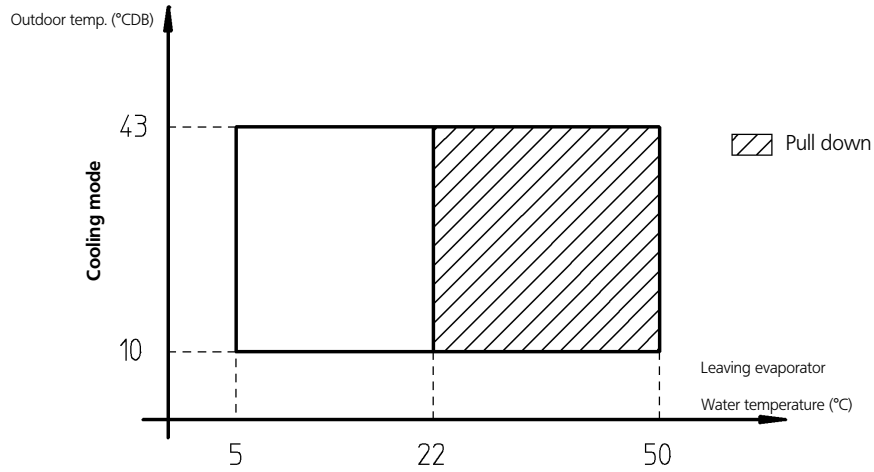
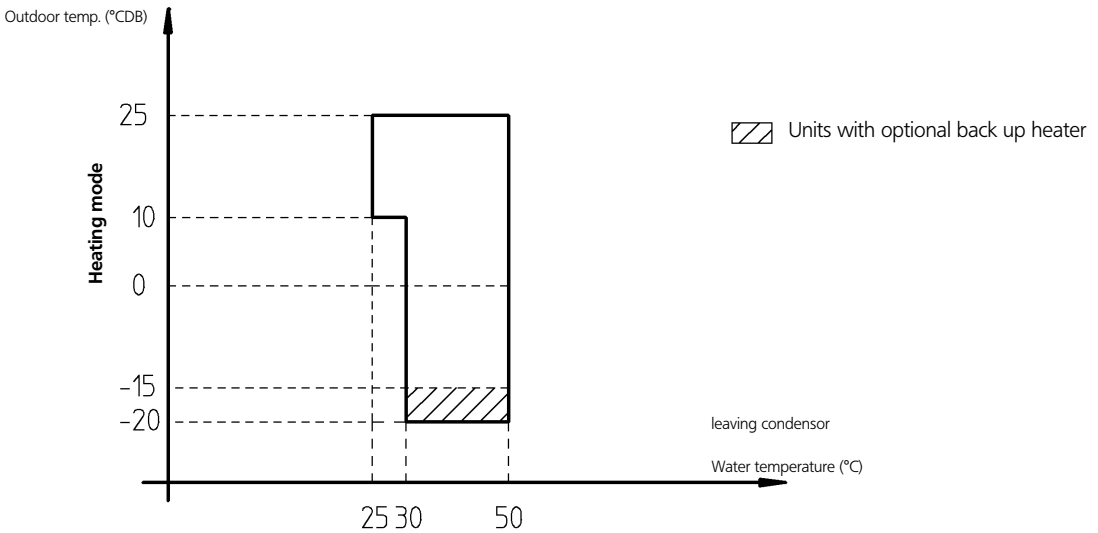
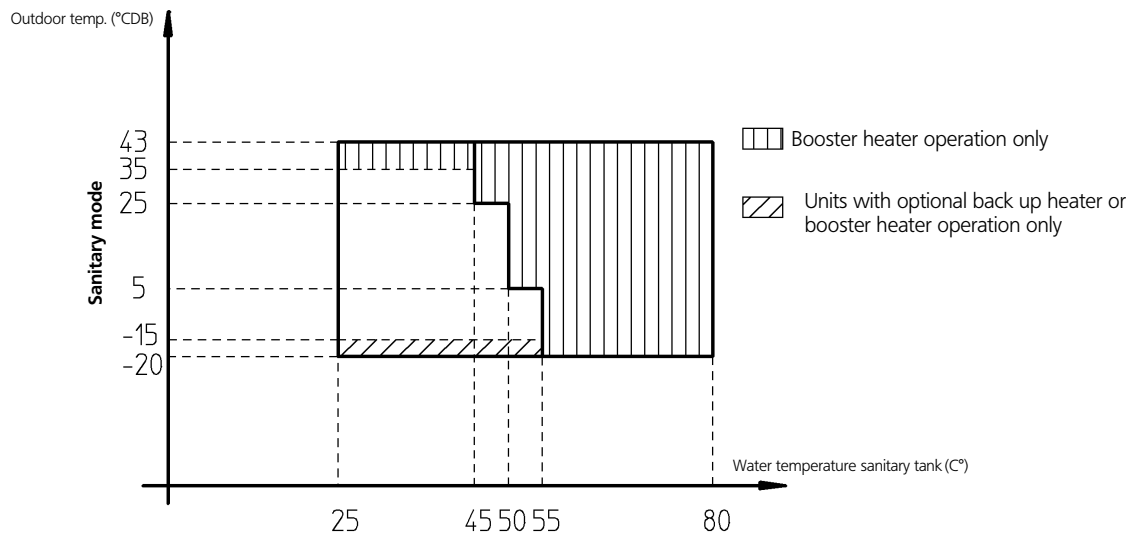

Outdoor temp. (°CDB)
43
10
Cooling mode
Pull down area
Leaving evaporator
Water temperature (°C)
5
22
50


Outdoor temp. (°CDB)
25
10
0
-15
-20
Heating mode
Units with optional back up heater
leaving condensor
Water temperature (°C)
25 30
50


Outdoor temp. (°CDB)
43
35
25
5
-15
-20
Sanitary mode
Booster heater operation only
Units with optional back up heater or booster heater operation only
Water temperature sanitary tank (C°)
25
45 50 55
80