



### Heating mode

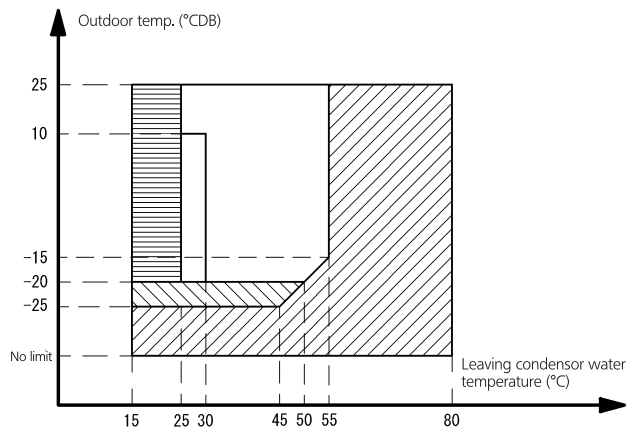

### Cooling mode

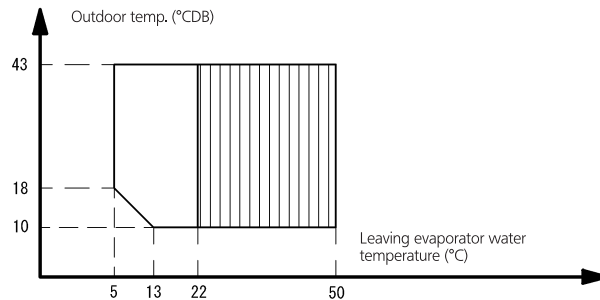

LEGEND:

: \* Outdoor unit operation possible if setpoint  $\geq 25^{\circ}\text{C}$   
 \* Boiler operation possible

: Boiler operation (Maximum condenser leaving water temperature is  $55^{\circ}\text{C}$ )

: Operation of outdoor unit possible, but no guarantee of capacity (if outdoor temperature  $< -25^{\circ}\text{C}$  outdoor unit will stop ) (indoor unit and boiler operation will continue)

: Pull down area