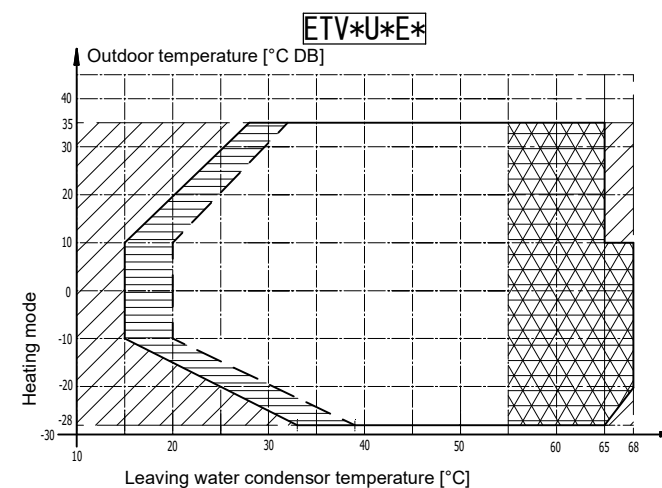
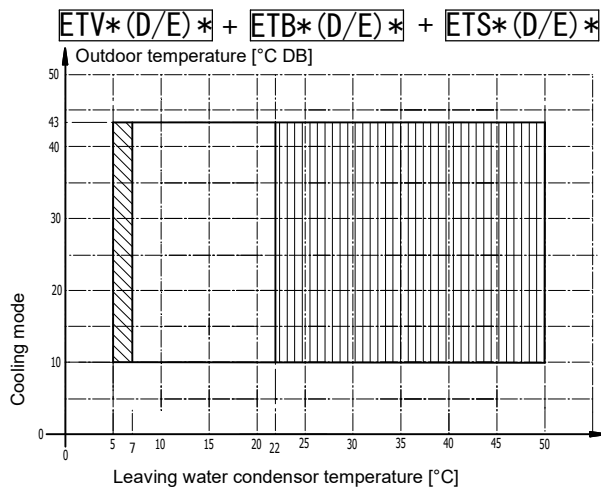
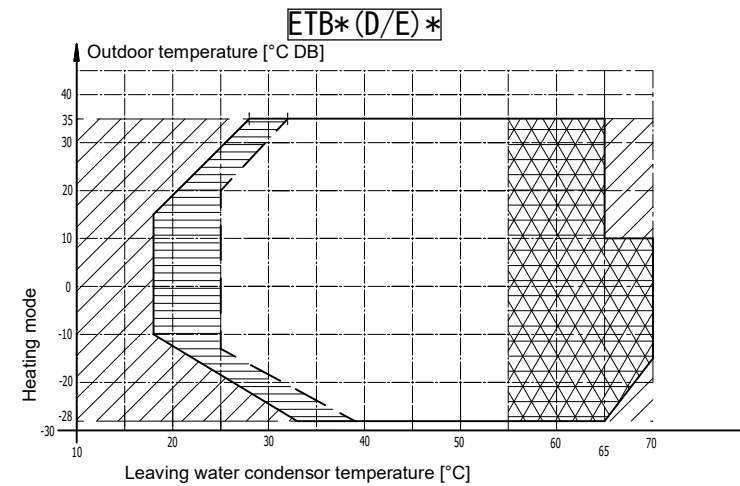
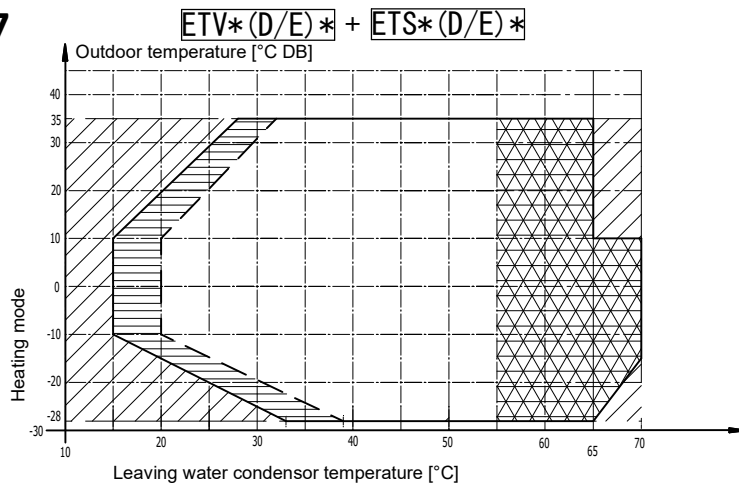








EPRA14-18DV7

EPRA14-18DW7



Legend

-  Backup heater only operation
-  No outdoor unit operation
-  Outdoor unit operation if controller setpoint is regulated to minimal leaving water temperature request. See dashed lines
-  Pull-down area
-  Outdoor unit operation if setpoint > 55 °C and $\Delta T = -10$ °C (ΔT = outlet temperature – inlet temperature)
-  In case valve kit 'AFVALVE1' is part of the system, then the minimum setpoint is -7 °C.

Remark

In restricted power supply mode, the outdoor unit, booster heater and backup heater can only operate separately.

3D125788D