



-k8° -† Heating
 -k8° -†°


RGA04

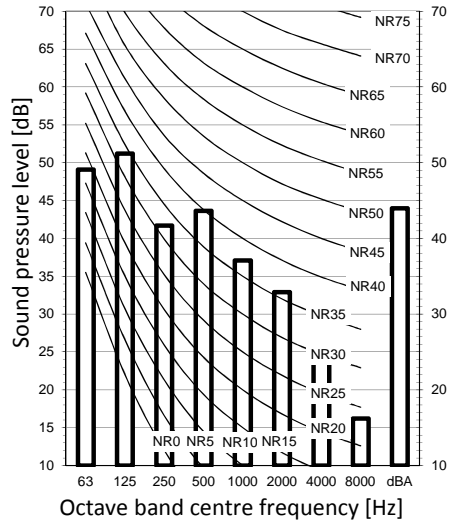

RGA06

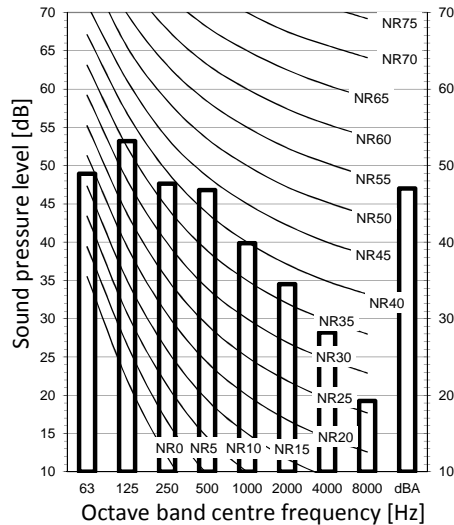


RGA08

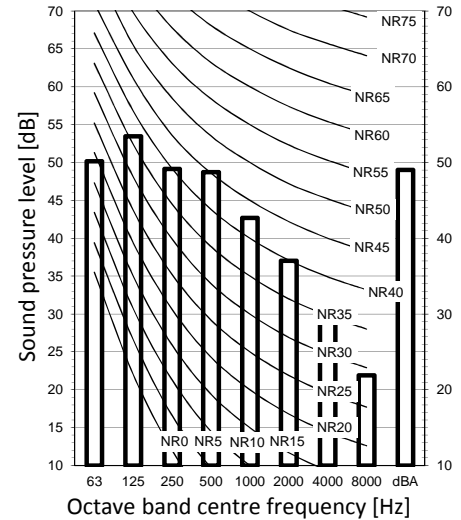

Notes

1. Data is valid at free field condition.
Measured in a semi-anechoic chamber
2. Data is valid at nominal operation condition.
3. dBA = A-weighted sound pressure level (A scale according to IEC).
4. Reference acoustic pressure 0 dB = 20 µPa
5. If the sound is measured under actual installation conditions, the measured value will be higher due to environmental noise and sound reflections.

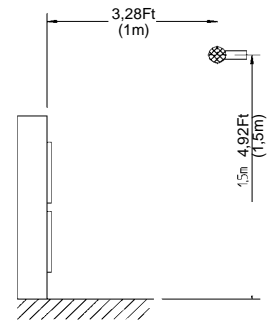

Measuring location (discharge side)