


ERHQ-BW17

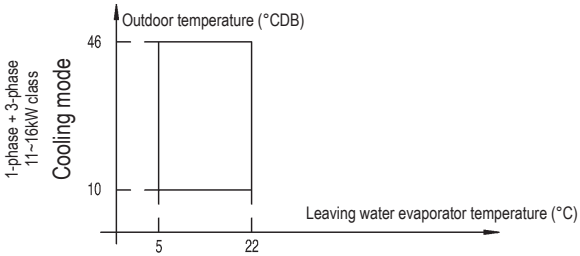

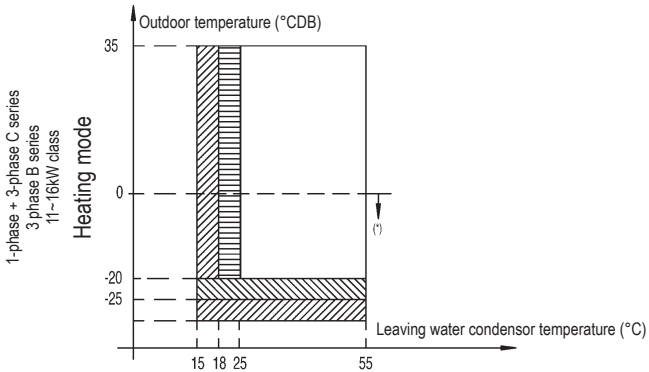

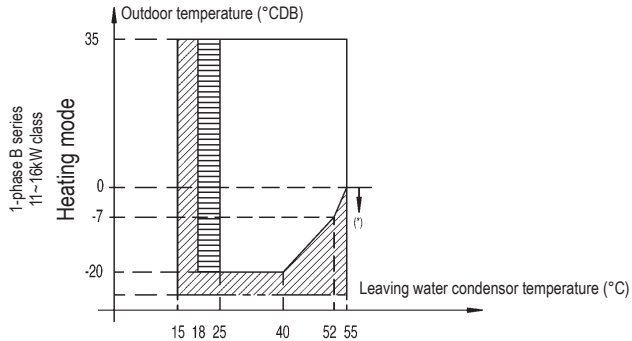

LEGEND

- Backup heater only operation
  No outdoor unit operation
- Outdoor unit operation if setpoint ≥ 25°C
- Operation of outdoor unit possible, but with possible capacity reduction.
  If the outdoor temperature < -25°C, the outdoor unit will stop.
  Indoor unit and backup heater operation will continue.
- Pull-down area

REMARK

In restricted power supply mode, the outdoor unit, booster heater and backup heater can only operate separately.

(*) *RLQ units include special equipment (insulation, heater sheet, ...) to ensure proper operation in areas with low ambient temperatures and high humidity conditions. In such conditions, the *RHQ models may experience problems with severe ice buildup on the air-cooled coil. If such conditions are expected, the *RLQ must be installed instead. These models contain countermeasures (insulation, heater sheet, ...) to prevent freeze-up.