
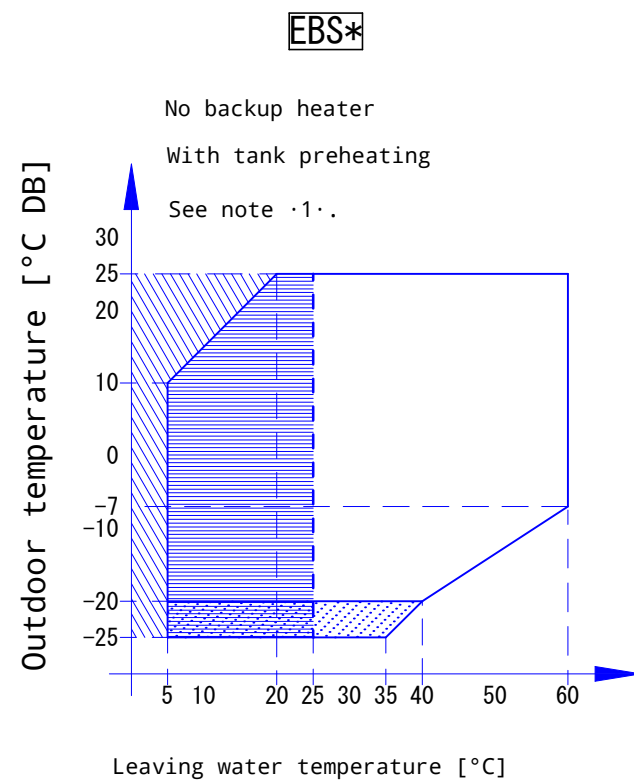
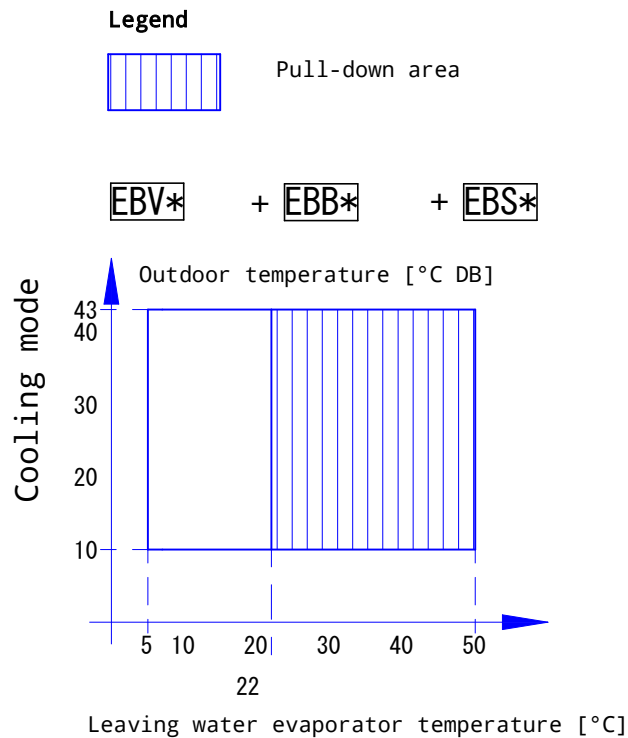


EBV* + EBB* + EBS*

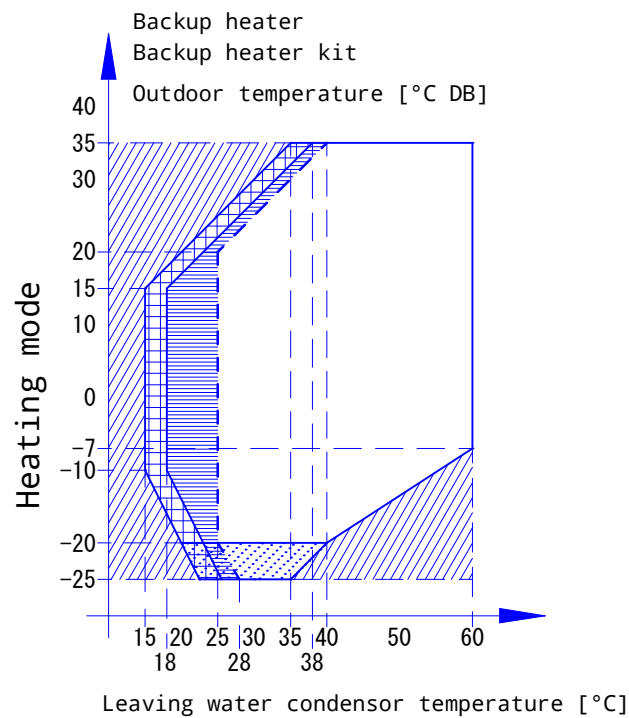

Legend

- Backup heater only operation
No outdoor unit operation
- Heat pump + backup heater operation
Pull-up area
- Outdoor unit operation if controller setpoint is regulated to minimal leaving water temperature request.
See dashed lines
- Operation of outdoor unit possible, but with possible capacity reduction.
- Circulation pump operation only

Notes

1. Tank preheating
For details, see the installer reference guide.
2. In restricted power supply mode, the outdoor unit and backup heater can only operate separately.