


- A = Minimum water flow rate during normal operation
- B = Minimum water flow rate during backup heater operation
- C = Minimum water flow rate during cooling operation
- D = Minimum water flow rate during defrost operation

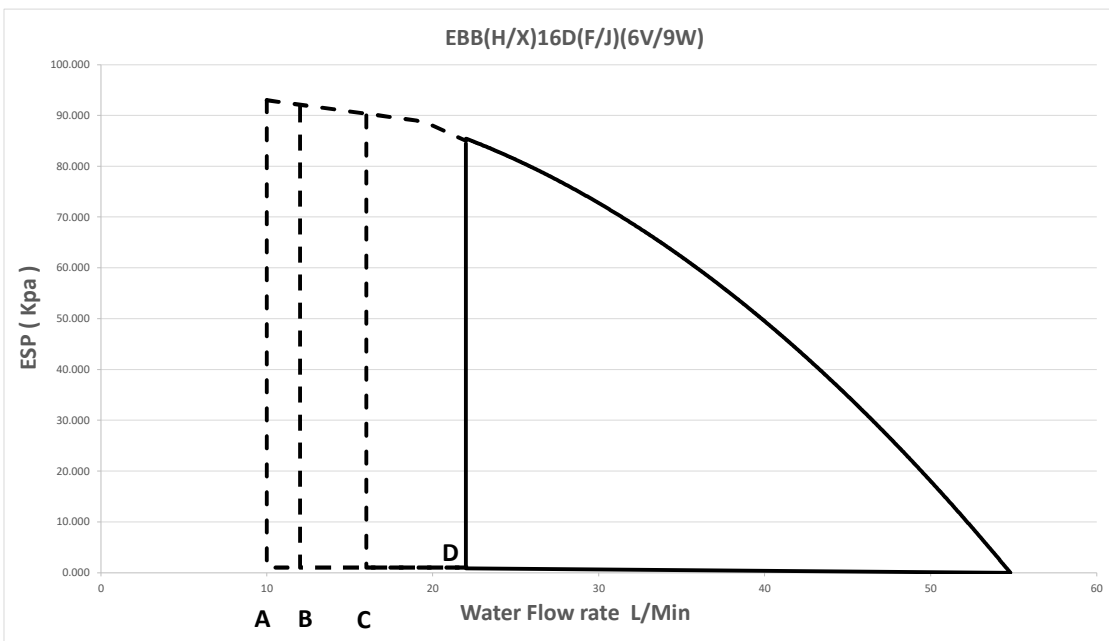

- A = Minimum water flow rate during normal operation
- B = Minimum water flow rate during backup heater operation
- C = Minimum water flow rate during cooling operation
- D = Minimum water flow rate during defrost operation

**Notes**

- 1 Selecting a flow outside the operating area can damage the unit or cause the unit to malfunction.  
 See also the minimum and maximum allowed water flow range in the technical specifications.
- 2 Water quality must be according to EU directive 2020/2184