
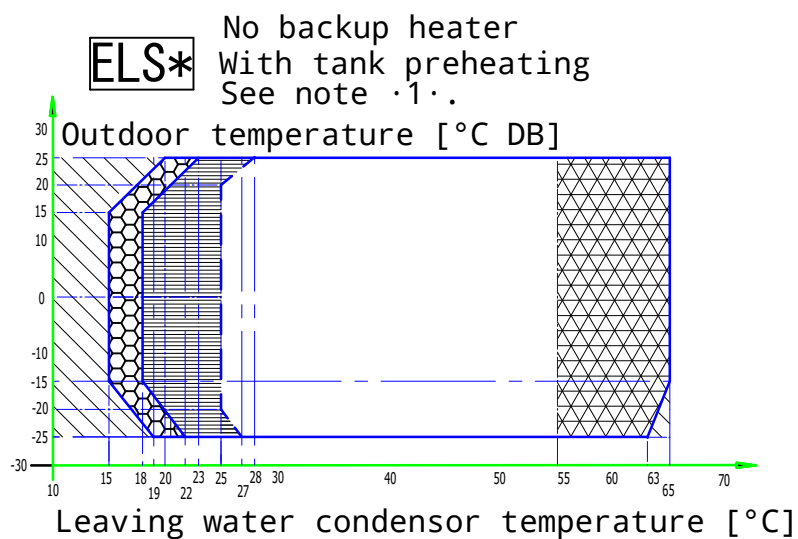
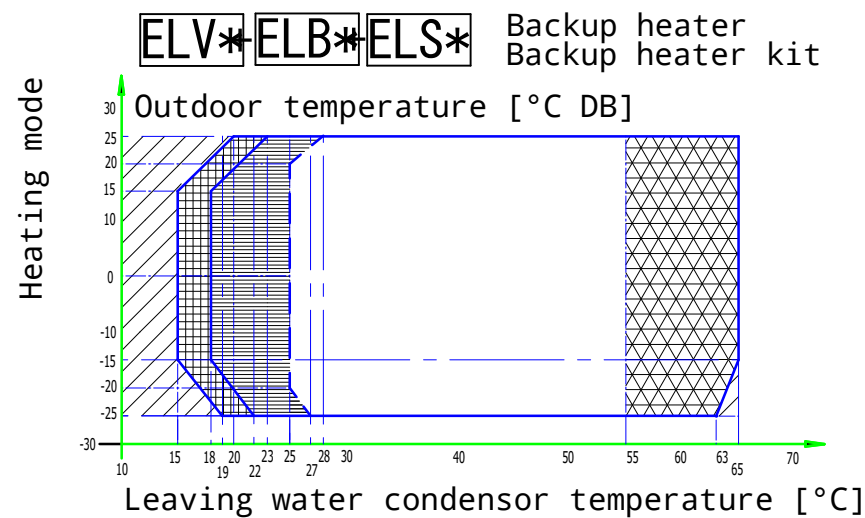


ERRA08-12EV3 ERRA08-12EW1

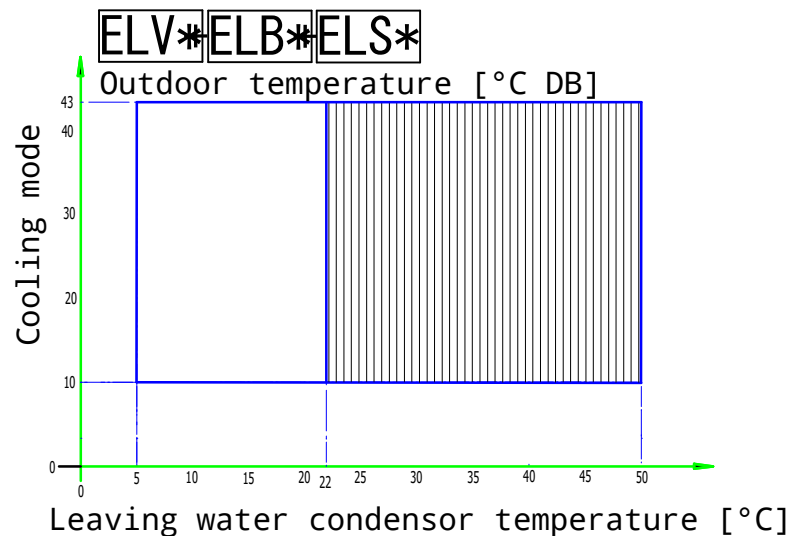

Legend

- Backup heater only operation
No outdoor unit operation
- Heat pump + backup heater operation
Pull-up area
- Auxiliary boiler only operation
No outdoor unit operation
- Heat pump + auxiliary boiler operation
Pull-up area
- Outdoor unit operation if controller setpoint is regulated to minimal leaving water temperature request.

See dashed lines

Outdoor unit operation if setpoint > 55°C and $\Delta T = 10^\circ\text{C}$ (ΔT = outlet temperature - inlet temperature)

Pull-down area

Notes

1. Tank preheating

For details, see the installer reference guide.

2. In restricted power supply mode, the outdoor unit and backup heater can only operate separately.