
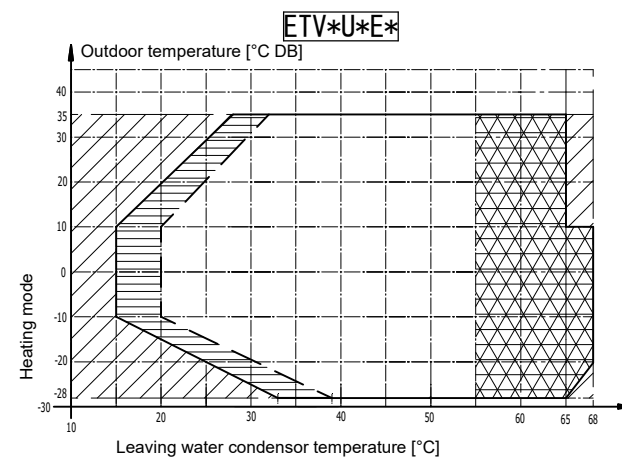
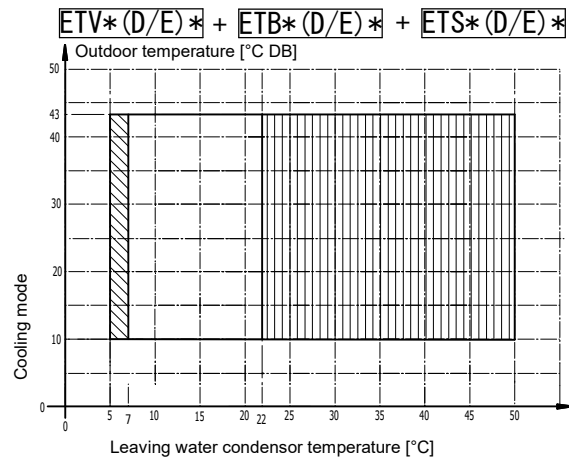
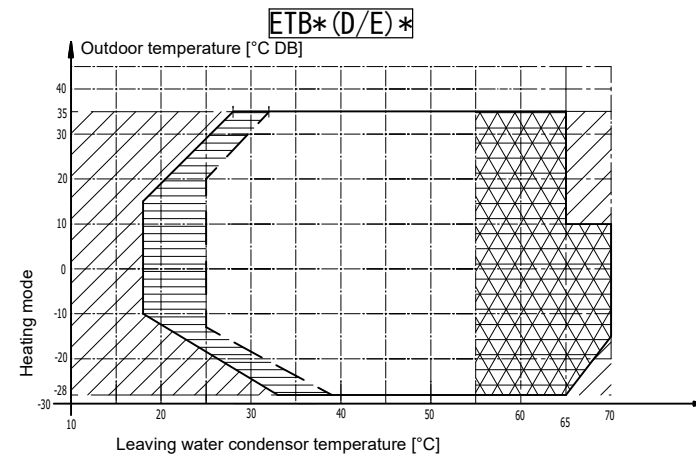


# ETSH16E7 ETSHB16E7 ETSX16E7 ETSXB16E7

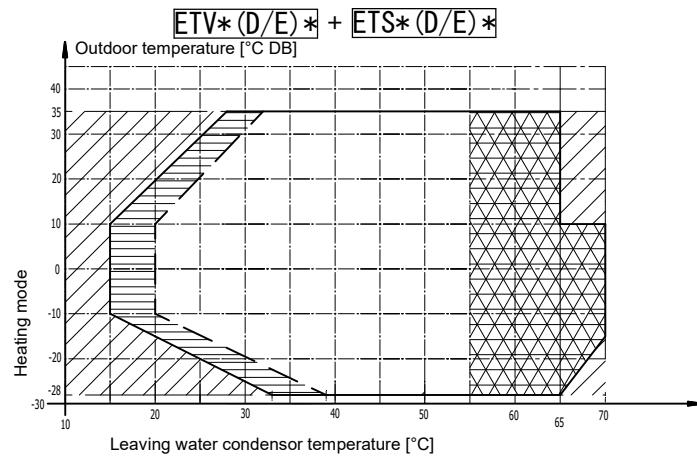

## Legend

- Backup heater only operation
- No outdoor unit operation
- Outdoor unit operation if controller setpoint is regulated to minimal leaving water temperature request.
- See dashed lines
- Pull-down area
- Outdoor unit operation if setpoint  $> 55^{\circ}\text{C}$  and  $\Delta T = -10^{\circ}\text{C}$  ( $\Delta T$  = outlet temperature – inlet temperature)
- In case valve kit ·AFVALVE1· is part of the system, then the minimum setpoint is  $-7^{\circ}\text{C}$ .

## Remark

In restricted power supply mode, the outdoor unit, booster heater and backup heater can only operate separately.