

- Legend
- Setpoint [°C]
Domestic hot water

... Leaving water temperature [°C]

Pull-up area

Booster heater only operation (if a booster heater is part of the system)

(1) Combination of ·EKHWS· and ·ETB*16*· indoor units / ·ETS*16*· indoor units only


(2) Combination of ·EKHWP· and ·ETB*16*· indoor units

Remark

1. In restricted power supply mode (·EKHW*· only), the outdoor unit, booster heater and backup heater can only operate separately.

2 Third-party with identical specifications as ·EHW*150*·
· Coil surface >·1.05·m2
Tank thermistor: top part of heat pump coil. Small overlap.

3 Third-party with identical specifications as ·EHW*200*·
· Coil surface >·1.8·m2
Tank thermistor: top part of heat pump coil. Small overlap.

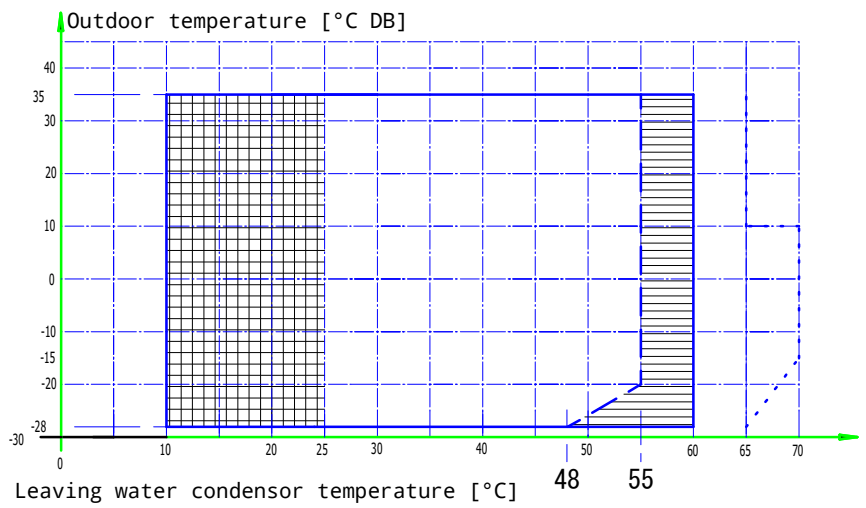

EKHWS*150*
EKHWS*180*

 +

Third-party with identical specifications as ·EKHWS*150*.