
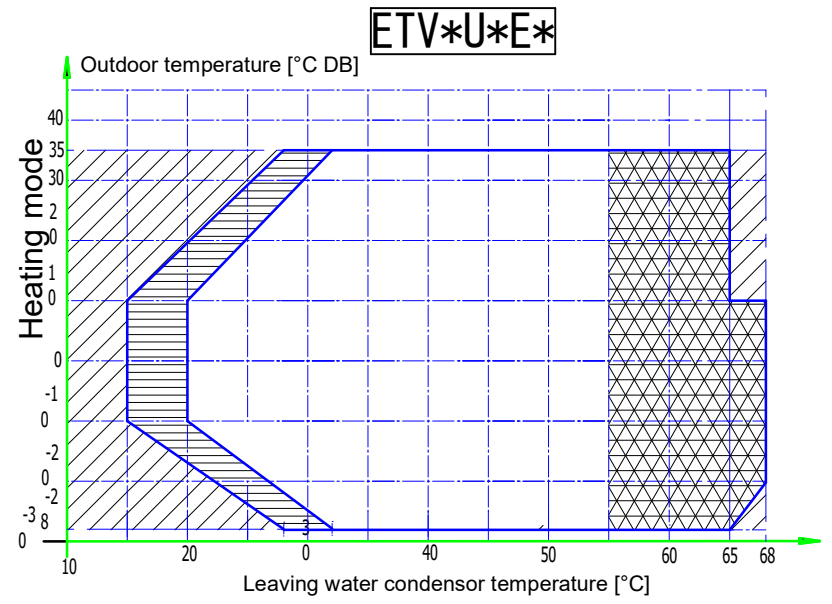
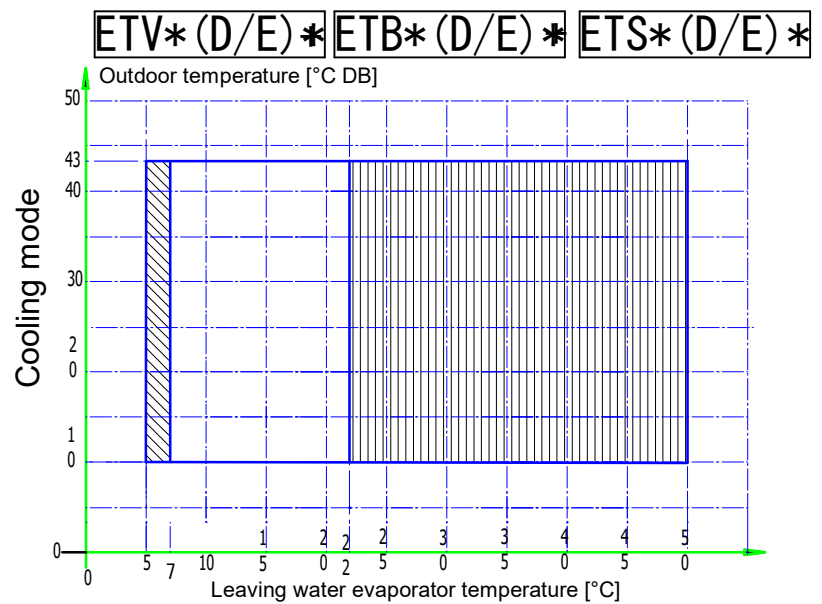
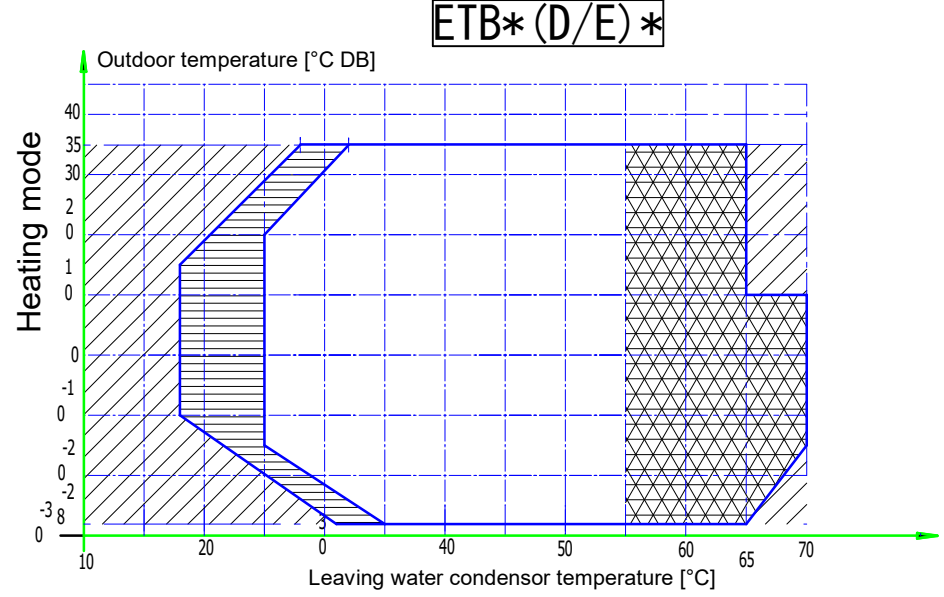


ETSH16E7
ETSHB16E7
ETSX16E7
ETSXB16E7

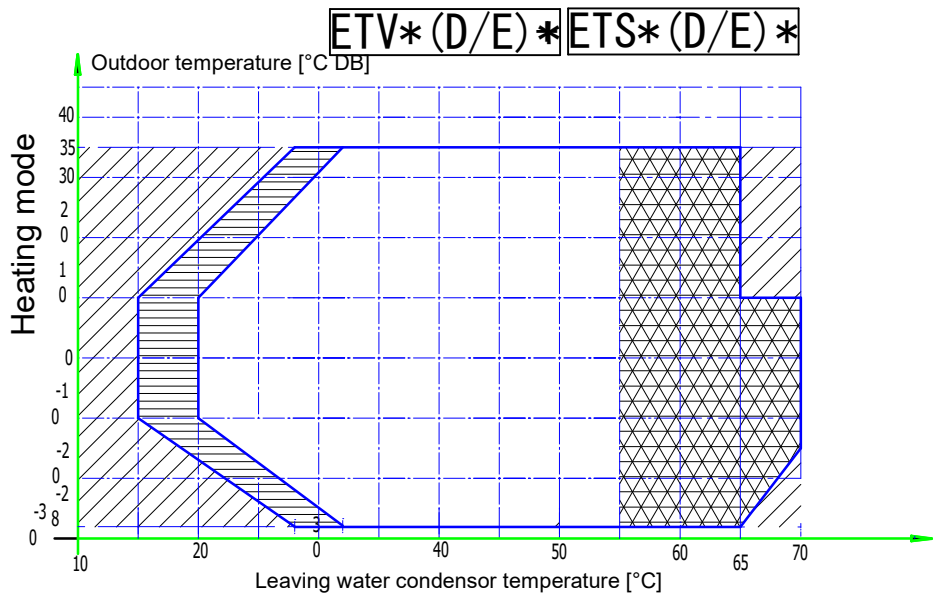

- Legend**
- Backup heater only operation
 - No outdoor unit operation
 - Outdoor unit operation if setpoint ≥ -20°
 - Pull-down area
 - Outdoor unit operation if setpoint > 55° and ΔT = -10° (ΔT = outlet temperature – inlet temperature)
 - In case valve kit ·AFVALVE1· is part of the system, then the minimum setpoint is -7°.

Remark
 In restricted power supply mode, the outdoor unit, booster heater and backup heater can only operate separately.