
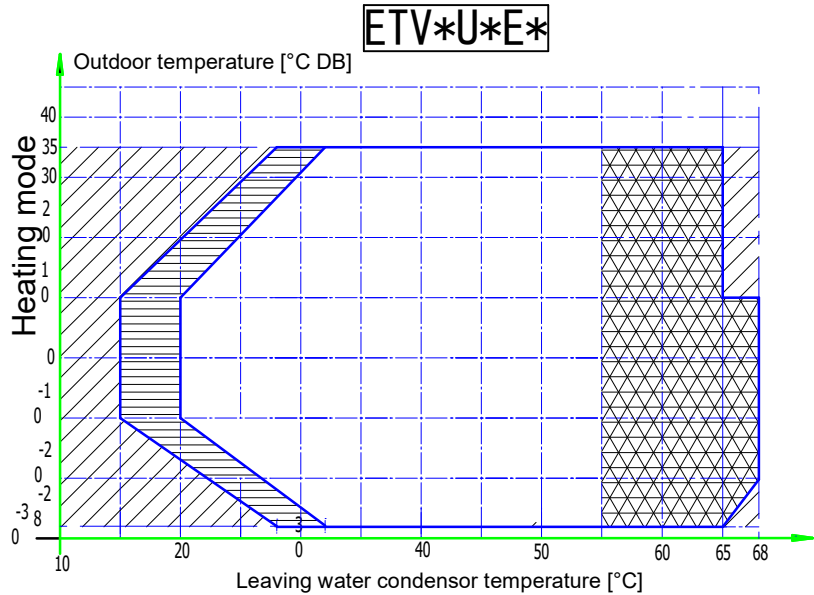
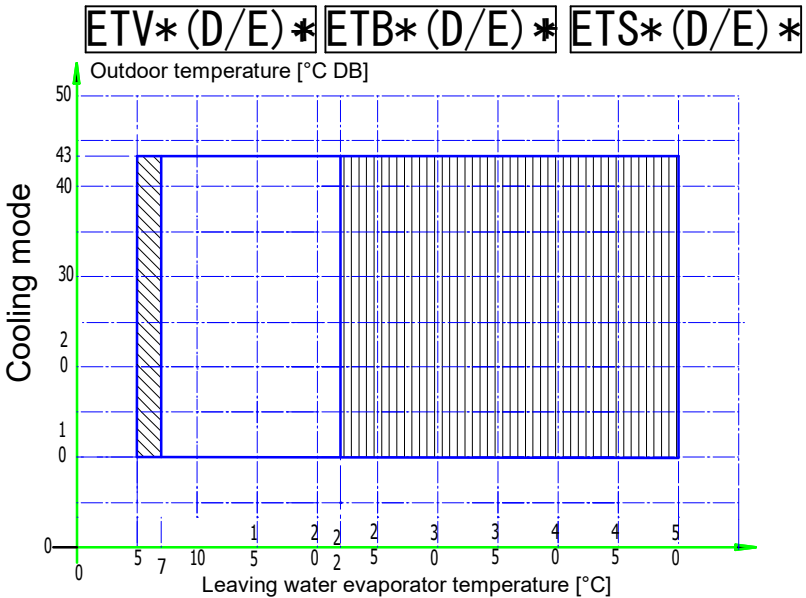
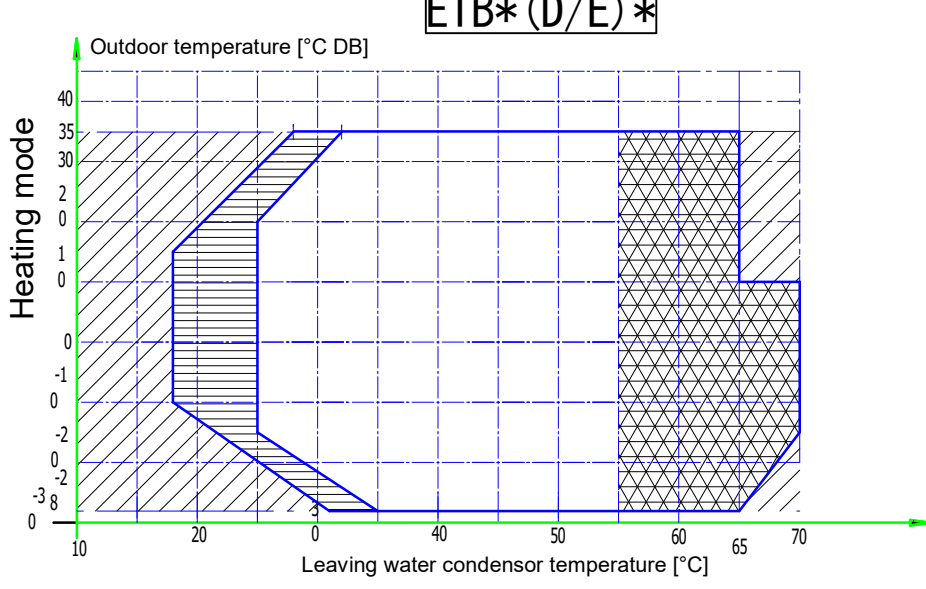


ETSH16E
 ETSHB16E
 ETSX16E
 ETSXB16E

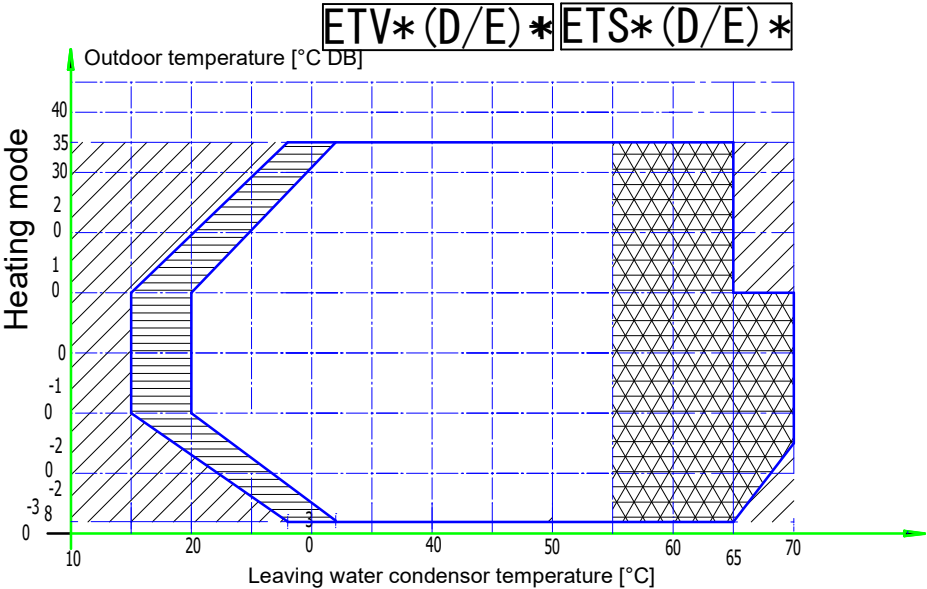

Legend

- Backup heater only operation
- No outdoor unit operation
- Outdoor unit operation if setpoint ≥ ·20·
- Pull-down area
- Outdoor unit operation if setpoint > ·55·°C and ΔT = ·10·°C (ΔT = outlet temperature – inlet temperature)
- In case valve kit ·AFVALVE1· is part of the system, then the minimum setpoint is ·7·°C.

Remark

In restricted power supply mode, the outdoor unit, booster heater and backup heater can only operate separately.