



EVLQ-CV3

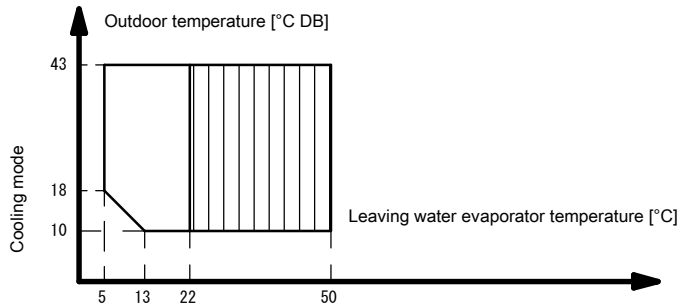

Legend

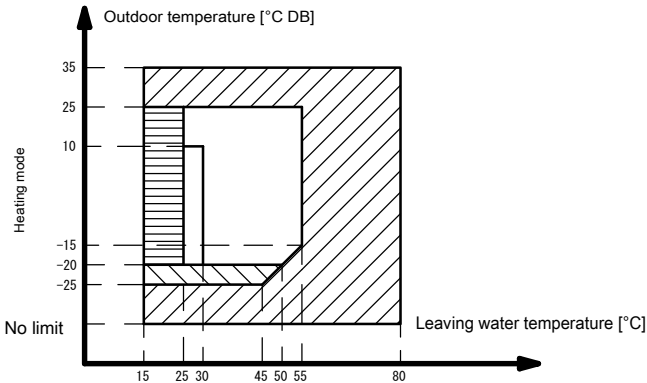



Outdoor unit operation if setpoint $\geq 25^{\circ}\text{C}$
Boiler operation possible.



Boiler operation (maximum condenser leaving water temperature is 55°C)



Operation of outdoor unit is possible, but no guarantee of capacity.
If the outdoor temperature $< -25^{\circ}\text{C}$, the outdoor unit will stop.
Indoor unit and boiler operation will continue.

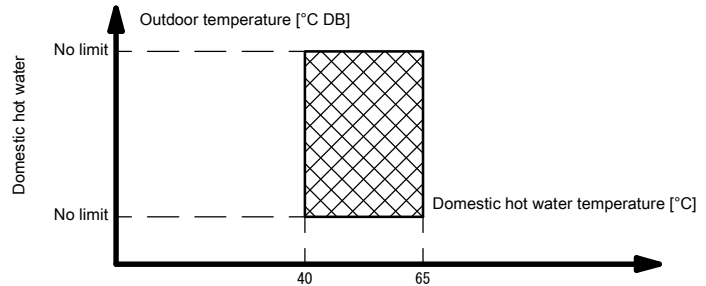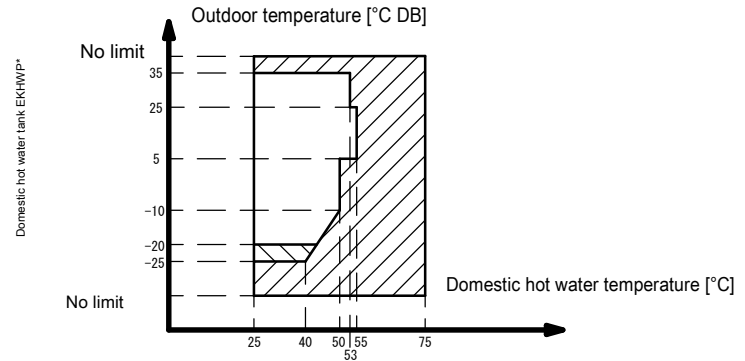

Pull-down area



Instant domestic hot water
Production always by boiler.

4D082876D