EBSH-D
EBSHB-D
EBSX-D
EBSXB-D

Electrical connection diagram HPSU Top Grade / TBM

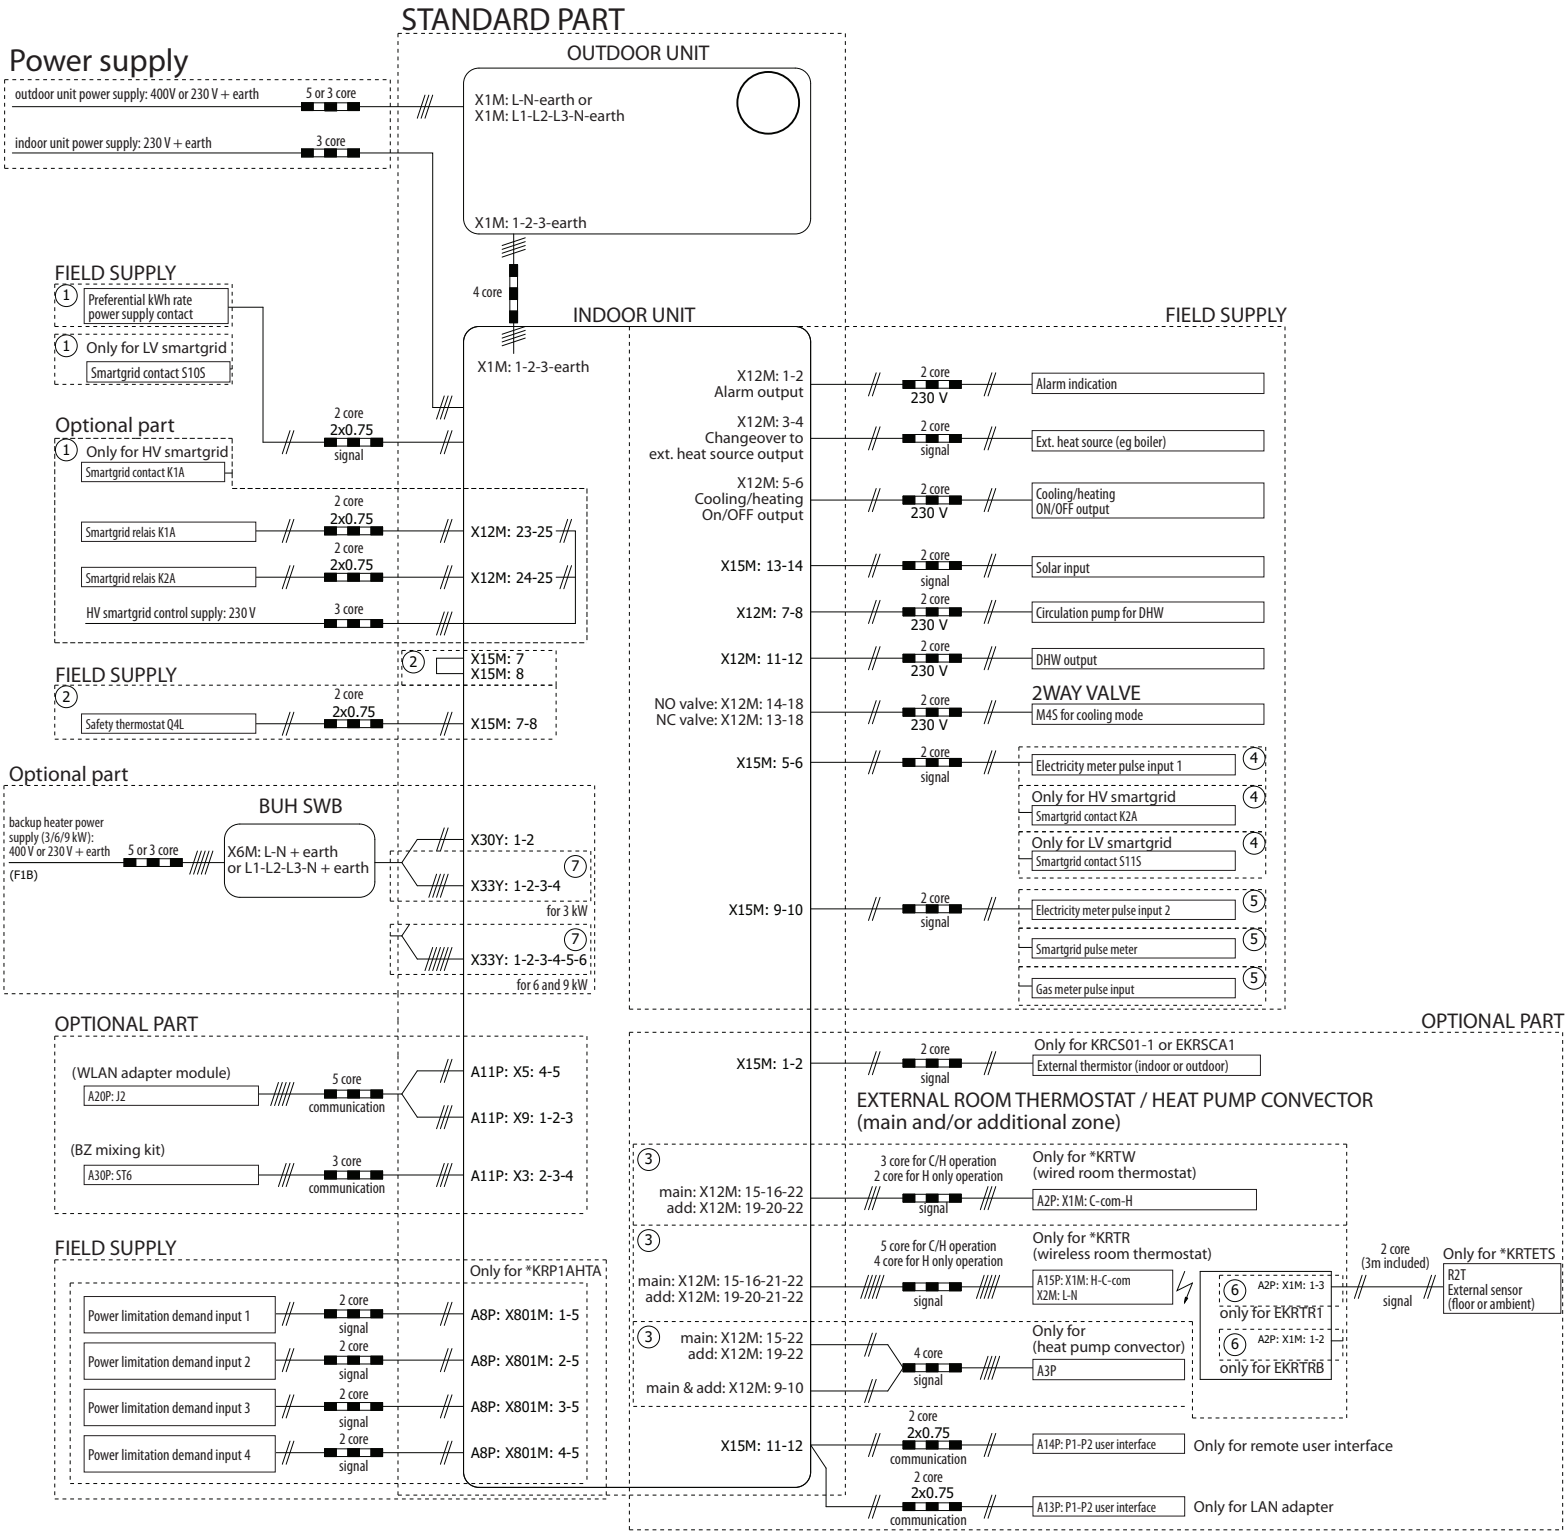

NOTE

- In case of signal cable: keep minimum distance to power cables > 5 cm

For more details please check unit wiring