


EPVX14A4V
EPVX14A9W
EPVX14UA4V

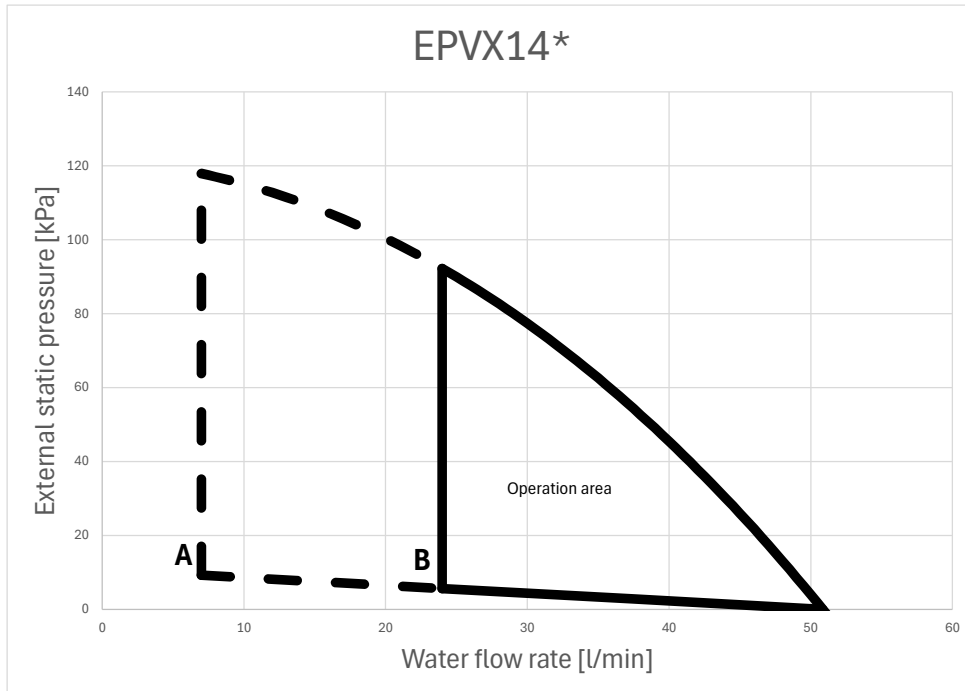

A Minimum water flow rate during normal operation

B Minimum water flow rate during defrost/backup heater operation

Operation area is extended to lower flow rates only in case the unit operates with heat pump only.
See dashed lines

Notes

1. Selecting a flow outside the operating area can damage the unit or cause the unit to malfunction.
See also the minimum and maximum allowed water flow range in the technical specifications.
2. Make sure water quality complies with EU Directive -2020/2184-
3. "External static pressure" is referring to a reference system installation including all mandatory options and 5 m piping of diameter 1.25" and 4 bends single run.