



LREQ-BY1R

For securing of capacity in the usage environment which outdoor temperature becomes lower than -10°C, installation of windbreak board or snowbreak hood is needed

Installation of windbreak board

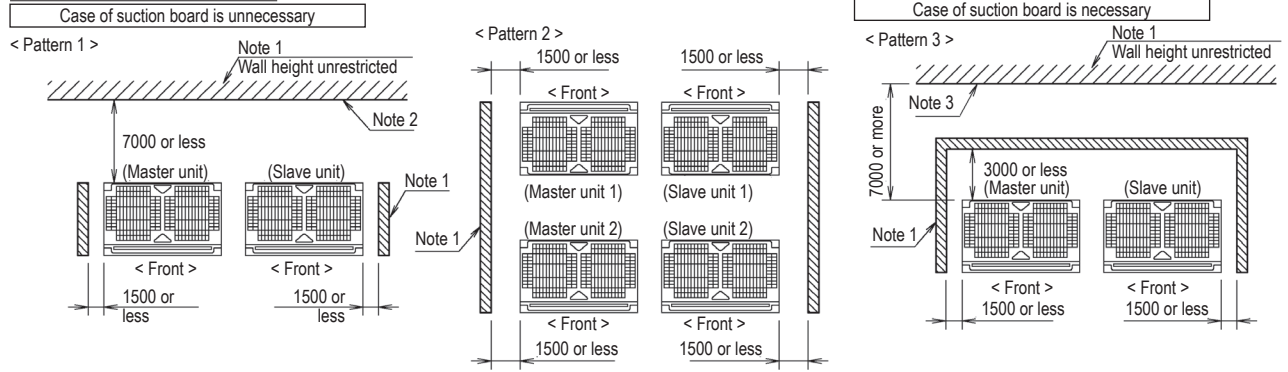


Installation of snowbreak hood

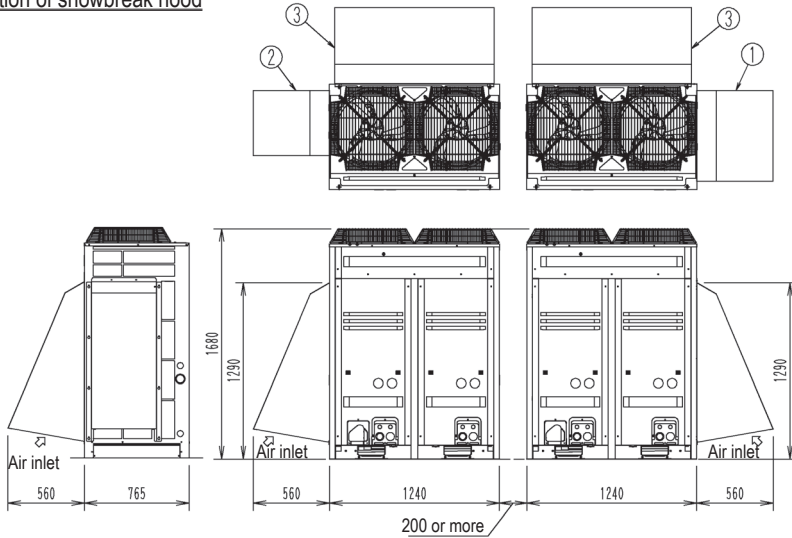


NOTES


1. Height board and wall: 1300mm or more.

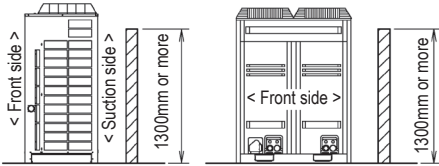

2. When outdoor units installed in rows, install side board to both sides.

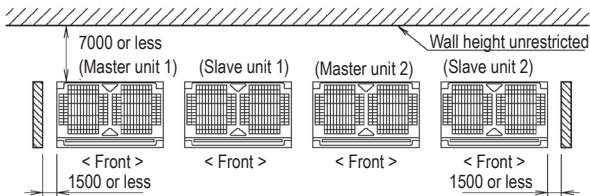

3. When there is no wall to suction side of each outdoor units, install windbreak board to suction side.

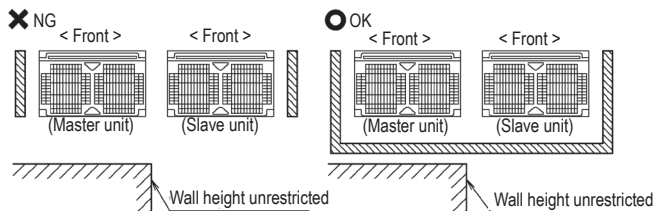

(Unit: mm)

※ Snowbreak hood set name: KPS26C504

No.	Parts name	Model name
1	Right side air inlet	KPS26C504R
2	Left side air inlet	KPS26C504L
3	Back side air inlet	KPS26C504B

4. For the installation space around outdoor units, see installation and repair space drawing. (3D085642).