


UATYA80BBAY1 UATYA120BBAY1 UATYA80BFC2Y1 UATYA120BFC2Y1 UATYA80BFC3Y1 UATYA120BFC3Y1

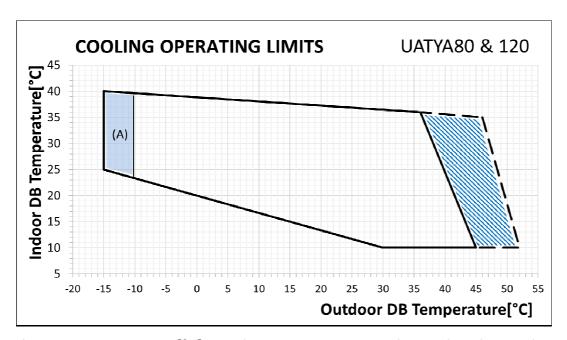

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the condensing coil (dry bulb). Indoor DB Temperature [°C]: Indoor air temperature that strikes the evaporating coil (dry bulb).

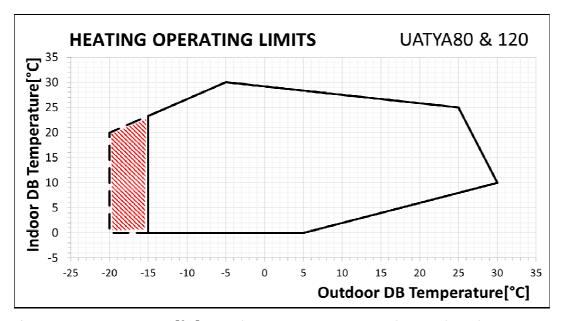

Outdoor DB Temperature [°C]: Outdoor air temperature that strikes the evaporating coil (dry bulb) **Indoor DB Temperature** [°C]: Indoor air temperature that strikes the condensing coil (dry bulb).

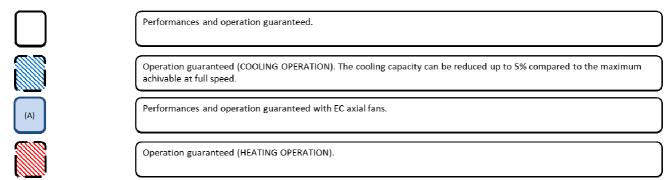

UATYA80BBAY1 UATYA120BBAY1 UATYA80BFC2Y1 UATYA120BFC2Y1 UATYA80BFC3Y1 UATYA120BFC3Y1

.