



**AZQS-BY1**  
**AZQS-B(8)V1**

Cooling mode

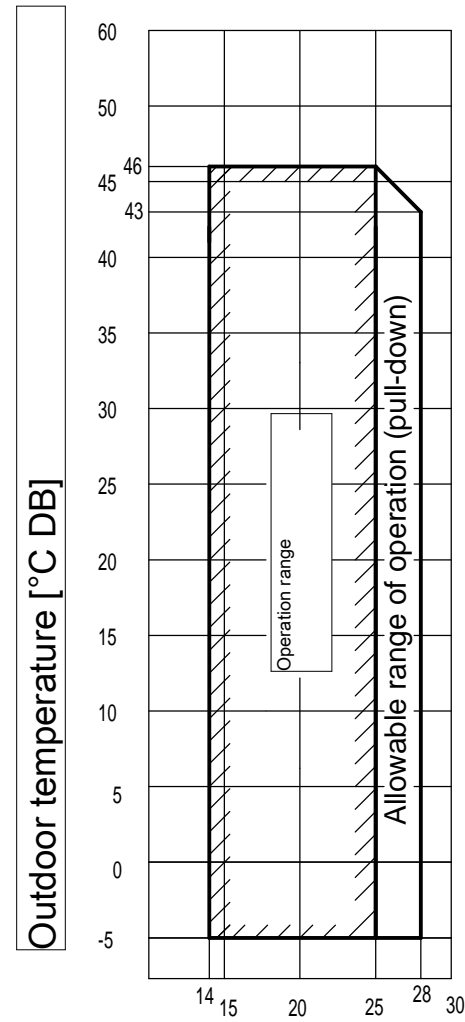

Indoor temperature [°C WB]

Heating mode

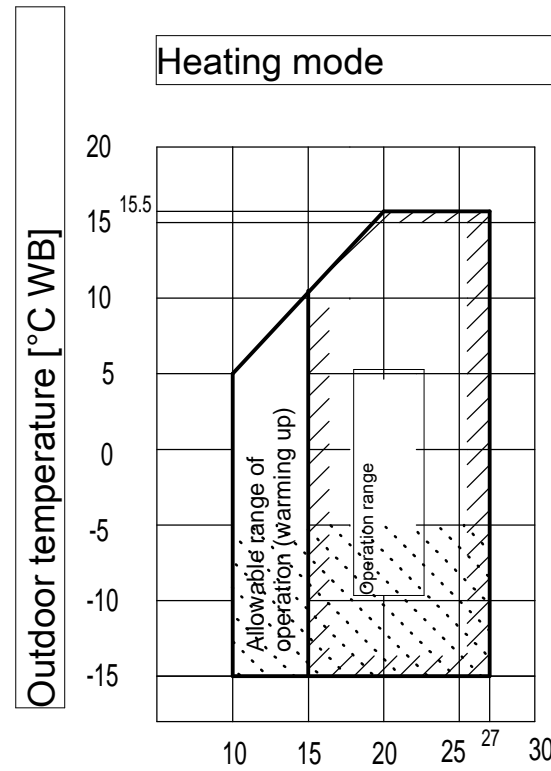

Indoor temperature [°C DB]

Notes

1. Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).
2. To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.
3. In case of high humidity conditions (>92%) in this operation area, a RZQG model should be used instead of a AZQS model. This to avoid freeze-up of the outdoor unit.