


RZQG100-140L9V1

Triple application

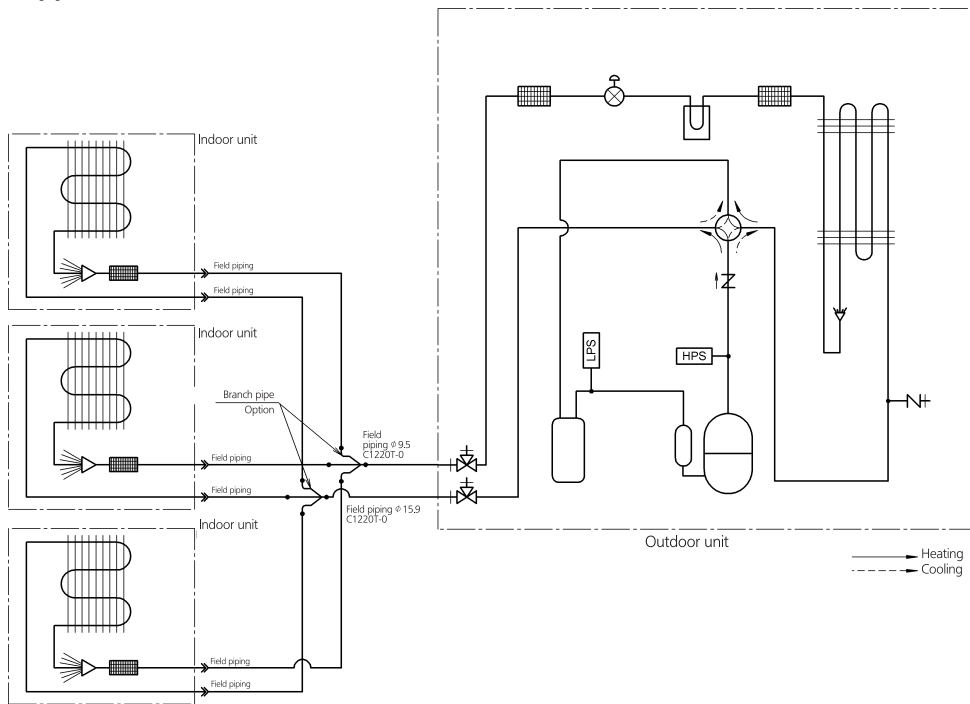

Notes:

- 1 The pipes between the branch and the indoor units should have the same size as the indoor connections.
- 2 The check valve is only present in following models: RZQSG100L and RZQSG125L.

