



**RZQSG140L9V1**  
**Cooling**

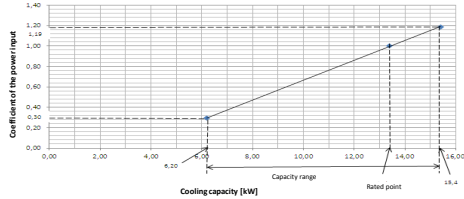

**Heating**

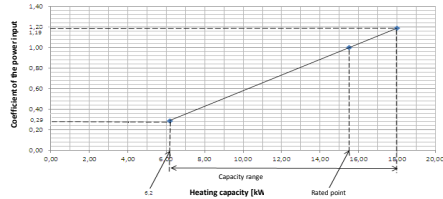

- Symbols**  
 AFR: Air flow rate [m<sup>3</sup>/min]  
 BF: Bypass factor  
 EWB: Entering wet-bulb temperature (°C WB)  
 EDB: Entering dry-bulb temperature (°C DB)  
 TC: Maximum total cooling/heating capacity [kW]  
 SHC: Sensible heat capacity [kW]  
 CPI: Coefficient of the power input  
 PI: Power input [kW]  
 compressor + indoor and outdoor fan motors

**Cooling**

Indoor	Outdoor temperature [°C DB]											
	25			30			35			40		
	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI
TCWB	TCDB	AW	AW	AW	AW	AW	AW	AW	AW	AW	AW	AW
15.0	22	15.5	10.47	0.95	14.9	10.25	1.08	14.4	10.03	1.16	13.9	9.89
18.0	26	16.2	10.55	0.96	15.6	10.21	1.09	15.1	10.01	1.19	14.5	9.71
19.0	27	16.6	10.43	0.99	16.0	10.18	1.09	<b>15.4</b>	<b>9.99</b>	<b>1.19</b>	14.8	9.76
19.5	27	16.7	10.48	0.99	16.1	10.16	1.10	15.6	10.00	1.19	15.0	9.86
22.0	30	17.6	10.37	0.98	17.0	10.16	1.10	16.4	9.83	1.21	15.8	9.60
24.0	32	18.4	10.20	1.00	17.7	10.00	1.11	17.0	9.67	1.22	16.4	9.47

**Heating**

Indoor	Outdoor temperature [°C WB]											
	-15.0		-10.0		-5.0		0.0		6.0		10.0	
	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI
TCDB	TCDB	AW	AW	AW	AW	AW	AW	AW	AW	AW	AW	AW
16	11.6	0.91	12.7	0.97	13.6	1.00	13.9	1.03	18.0	1.09	19.4	1.16
18	11.6	0.95	12.7	1.00	13.6	1.04	13.9	1.07	18.0	1.14	19.4	1.21
20	11.6	0.99	12.7	1.05	13.5	1.09	13.9	1.11	<b>19.0</b>	<b>1.19</b>	19.4	1.25
21	11.5	1.00	12.7	1.06	13.5	1.11	13.9	1.13	18.0	1.21	19.4	1.28
22	11.5	1.02	12.7	1.08	13.5	1.12	13.9	1.16	18.0	1.24	19.4	1.30
24	11.5	1.07	12.6	1.12	13.5	1.17	13.9	1.20	18.0	1.29	19.4	1.35

**Notes**

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- = Maximum at standard conditions  
 = Rated capacity and rated coefficient of the power input  
 The maximum capacity is not guaranteed except at standard conditions.
- SHC is based on indoor units EWB & EDB.  
 SHC for other dry-bulb temperatures = SHC + SHC\*  
 SHC\* = SHC correction for other dry-bulb temperatures  
 = 0.02 x AFR (m<sup>3</sup>/min) x (1-BF) x (DB\* - EDB)
- The capacities are based on the following conditions:  
 Outdoor air: 85% RH  
 However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.  
 Corresponding refrigerant piping length: 5.0 m  
 Level difference: 0m
- CPI is a percentage value compared to the rated value which is 1.00.
- The error rate for this value is less than 5% and depends on the indoor unit type.
- The heating performance takes into account the drop that occurs during defrost operation.
- The air flow rate and bypass factor are mentioned in the table.

9. The rated power input for each model is mentioned in the table below.

Pair	FCQHS140F	FCQSL140F	FRQSL140C	FRQSL140C	FVQSL140C	FRQSL140CA
AFR	33.5	33.0	39.4	41.1	38.0	34.0
(BF)	(0.15)	(0.23)	(0.14)	(0.17)	(0.10)	(0.17)

Twin	FCQHS71F X 2	FCQSL71F X 2	FRQSL71C X 2	FRQSL71C X 2	FRQSL71CA X 2
AFR	21.3 x 2	21.5 x 2	28.0 x 2	20.5 x 2	20.5 x 2
(BF)	(0.2 x 2)	(0.14 x 2)	(0.08 x 2)	(0.13 x 2)	(0.13 x 2)

Triple	FCQHS59F X 3	FRQSL59C X 3	FRQSL59CA X 3	FRQSL59C X 3	FRQHS59F X 3
AFR	12.6 x 3	15 x 3	15 x 3	12 x 3	12.6 x 3
(BF)	(0.22 x 3)	(0.16 x 3)	(0.18 x 3)	(0.16 x 3)	(0.11 x 3)

Double twin	FCQHS39F X 4	FRQSL39C X 4	FRQSL39CA X 4	FRQSL39C X 4	FRQHS39F X 4
AFR	12.5 x 4	16.4 x 4	14.4 x 4	10.4 x 4	8.7 x 4
(BF)	(0.4 x 4)	(0.15 x 4)	(0.20 x 4)	(0.25 x 4)	(0.17 x 4)

Pair	FCQHS140F	FCQSL140F	FRQSL140C	FRQSL140C	FVQSL140C	FRQSL140CA
Cooling	4.17	4.45	4.44	4.45	4.45	4.45
Heating	4.29	4.54	4.54	4.54	4.54	4.54

Twin	FCQHS71F X 2	FCQSL71F X 2	FRQSL71C X 2	FRQSL71C X 2	FRQSL71CA X 2
Cooling	4.11	4.39	4.37	4.01	4.23
Heating	4.23	4.48	4.54	4.71	4.92

Triple	FCQHS59F X 3	FRQSL59C X 3	FRQSL59CA X 3	FRQSL59C X 3	FRQHS59F X 3
Cooling	4.40	4.27	4.67	4.41	4.68
Heating	4.48	4.94	5.67	4.39	4.61

Double twin	FCQHS39F X 4	FRQSL39C X 4	FRQSL39CA X 4	FRQSL39C X 4	FRQHS39F X 4
Cooling	4.56	4.17	4.65	4.11	4.68
Heating	4.54	4.94	5.57	4.05	6.09