



RZQ250C

Cooling

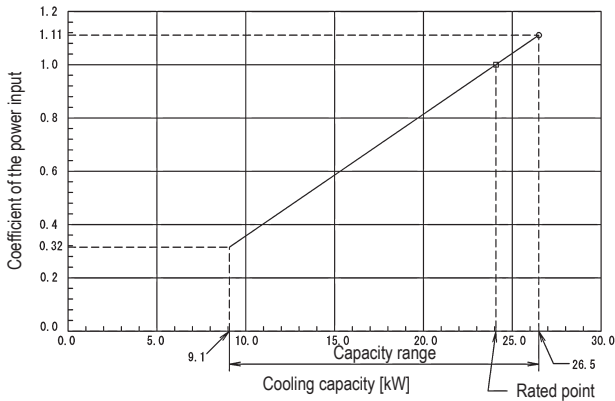

Indoor °CWB	Outdoor temperature [°C DB]											
	25			30			35			40		
	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI
16	24.5	21.5	0.79	23.5	20.7	0.88	22.5	19.8	0.98	21.5	19.0	1.09
18	25.7	21.5	0.80	24.6	20.6	0.89	23.6	19.8	0.99	22.5	18.9	1.09
19	26.2	21.5	0.80	25.2	20.6	0.90	24.1	19.8	1.00	23.0	19.0	1.10
20	26.8	21.4	0.81	25.7	20.5	0.91	24.6	19.7	1.01	23.5	18.9	1.11
22	28.0	21.2	0.81	26.8	20.3	0.92	25.7	19.5	1.02	24.5	18.7	1.12
24	29.1	20.9	0.82	27.9	20.1	0.93	26.7	19.3	1.03	25.6	18.4	1.13

Heating

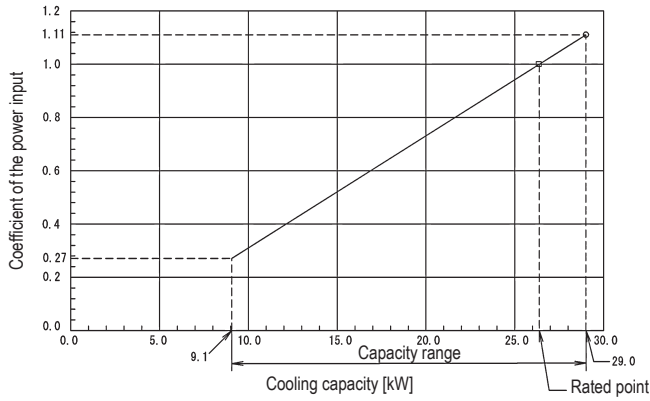

Indoor °CWB	Outdoor temperature [°C DB]											
	-15		-10		-5		0		6		10	
	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI
16	13.2	0.77	14.7	0.82	16.6	0.87	18.4	0.91	26.9	0.92	29.2	0.98
18	13.1	0.80	14.6	0.85	16.4	0.90	18.2	0.95	26.6	0.96	28.9	1.02
20	12.9	0.84	14.5	0.88	16.3	0.94	18.0	0.99	26.4	1.00	28.7	1.06
22	12.8	0.87	14.3	0.92	16.1	0.97	17.9	1.03	26.2	1.04	28.4	1.10
24	12.7	0.90	14.2	0.95	16.0	1.01	17.7	1.06	25.9	1.08	28.2	1.14

- NOTES**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - = Maximum at standard conditions
 = Rated capacity and rated coefficient of the power input.
The maximum capacity is not guaranteed except at standard conditions.
 - SHC is based on indoor EWB and EDB.
SHC for other dry bulb temperature = SHC + SHC*.
SHC* = SHC correction for other dry-bulb
= 0.02 x AFR (m³/min) x (1-BF) x (DB*-EDB).
 - The capacities are based on the following conditions:
Outdoor air: 85% RH
However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
Corresponding refrigerant piping length: 5.0 m
Level difference: 0 m
 - CPI is a percentage value compared to the rated value which is 1.00.
 - The error rate for this value is less than 5% and depends on the indoor unit type.
 - The heating performance takes into account the drop that occurs during defrost operation.
 - The air flow rate and bypass factor are mentioned in the table.

Twin	FCAHG125H x 2	FCAHG125B x 2	FHQ125CA x 2	FUQ100C x 2
AFR	33.5 x 2	33 x 2	31 x 2	32.5 x 2
(BF)	(0.19 x 2)	(0.21 x 2)	(0.134 x 2)	(0.19 x 2)
Double twin	FCAG60B x 4	FHQ60CA x 4		
AFR	13.6 x 4	19.5 x 4		
(BF)	(0.2 x 4)	(0.20 x 4)		

9. The rated power input for each model is mentioned in the table below.
- | Twin | FCAHG120H x 2 | FCAG125B x 2 | FHQ125CA x 2 | FUQ125C x 2 |
|-------------|---------------|--------------|--------------|-------------|
| Cooling | 8.77 | 9.80 | 10.20 | 9.31 |
| Heating | 7.48 | 9.25 | 8.63 | 8.31 |
| Double twin | FCAG60B x 4 | FHQ60CA x 4 | | |
| Cooling | 11.10 | 9.89 | | |
| Heating | 9.88 | 9.43 | | |

- SYMBOLS**
- AFR : Air flow rate [m³/min]
 - BF : Bypass factor
 - EWB : Entering wet-bulb temperature (°C WB)
 - EDB : Entering dry-bulb temperature (°C DB)
 - TC : Maximum total cooling/heating capacity [kW]
 - SHC : Sensible heat capacity [MBh]
 - CPI : Coefficient of the power input
 - PI : Power Input [kW]
compressor + indoor and outdoor fan motors

- CAUTION**
TC and SHC are shown by kW