
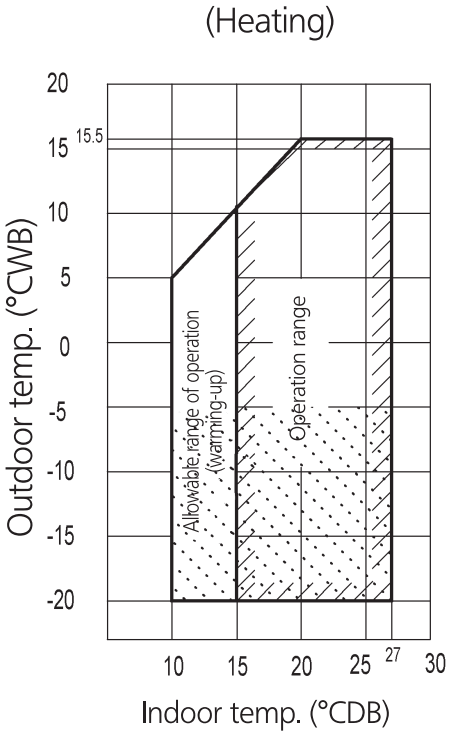


**RZQG-L(8)Y1**  
**RZQG-L9V1**

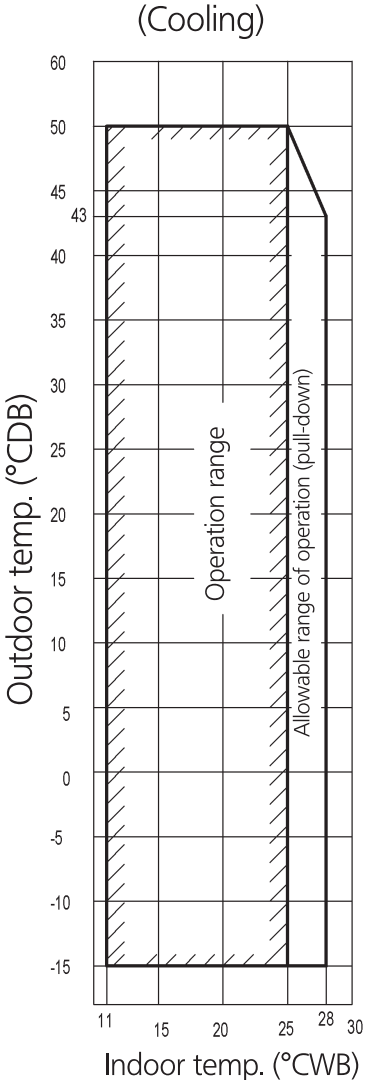

**Notes:**

- 1 Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).
- 2 To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.
- 3 If the unit has to operate for 5 days in this [dotted] operation range with 100% humidity, it is advisable to install the optional bottom plate heater.