



# RZQG100L9V1

# RZQG100L8Y1

## Cooling

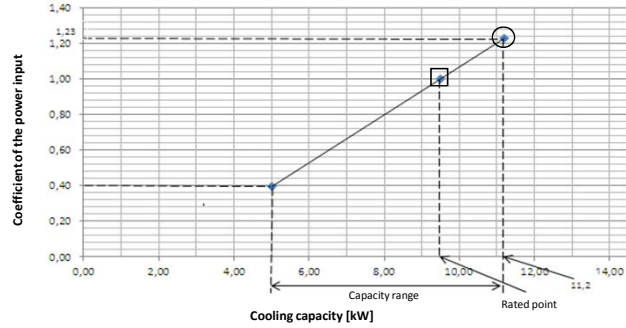

## Heating

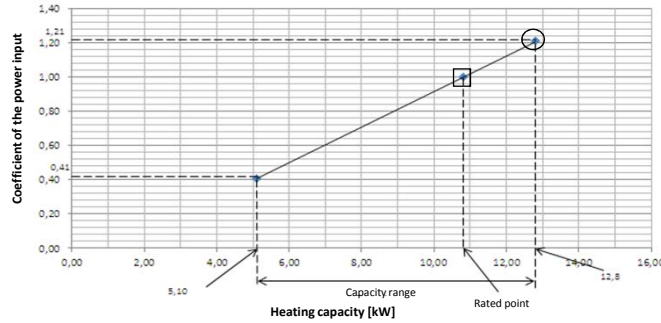

### Symbols

- AFR: Air flow rate [m³/min]
  - BF: Bypass factor
  - EWB: Entering wet-bulb temperature (°C WB)
  - EDB: Entering dry-bulb temperature (°C DB)
  - TC: Maximum total cooling/heating capacity [kW]
  - SHC: Sensible heat capacity [kW]
  - CPI: Coefficient of the power input
  - PI: Power input [kW]
- compressor + indoor and outdoor fan motors

## Cooling

Indoor		Outdoor temperature [°C DB]											
		25			30			35			40		
°CWB	°CDB	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI
16,0	22	11,20	7,61	1,01	10,85	7,44	1,11	10,50	7,29	1,22	10,11	7,09	1,32
18,0	25	11,80	7,59	1,01	11,37	7,49	1,12	11,00	7,27	1,23	10,55	7,09	1,33
19,0	27	12,00	7,57	1,02	11,62	7,44	1,12	<b>11,20</b>	<b>7,26</b>	<b>1,23</b>	10,80	7,04	1,33
19,5	27	12,15	7,59	1,02	11,74	7,37	1,13	11,43	7,34	1,23	10,91	7,04	1,34
22,0	30	12,80	7,52	1,02	12,37	7,36	1,13	11,90	7,16	1,24	11,52	7,03	1,35
24,0	32	13,30	7,42	1,03	12,88	7,27	1,14	12,40	7,06	1,25	11,97	6,91	1,36

## Heating

Indoor		Outdoor temperature [°C WB]											
		-15,0		-10,0		-5,0		0,0		6,0		10,0	
°CDB	°CWB	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI
16	22	8,58	0,92	9,45	0,98	10,1	1,02	10,4	1,05	12,8	1,11	13,8	1,18
18	25	8,57	0,97	9,44	1,02	10,0	1,06	10,3	1,09	12,8	1,16	13,8	1,23
19	27	8,56	1,00	9,43	1,06	10,0	1,11	10,3	1,13	<b>12,8</b>	<b>1,21</b>	13,8	1,27
20	27	8,56	1,02	9,42	1,08	10,0	1,12	10,3	1,15	12,8	1,23	13,8	1,30
22	30	8,55	1,04	9,42	1,10	10,0	1,14	10,3	1,18	12,8	1,26	13,8	1,32
24	32	8,54	1,08	9,41	1,14	10,0	1,19	10,3	1,22	12,8	1,31	13,8	1,37

### Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- = Maximum at standard conditions  
□ = Rated capacity and rated coefficient of the power input  
The maximum capacity is not guaranteed except at standard conditions.
- SHC is based on indoor units EWB & EDB.  
SHC for other dry-bulb temperatures = SHC + SHC\*  
SHC\* = SHC correction for other dry-bulb temperatures  
= 0.02 x AFR (m³/min) x (1-BF) x (DB\* - EDB)
- The capacities are based on the following conditions:  
Outdoor air: 85% RH  
However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.  
Corresponding refrigerant piping length: 5.0 m  
Level difference: 0m
- CPI is a percentage value compared to the rated value which is 1.00.
- The error rate for this value is less than 5% and depends on the indoor unit type.
- The heating performance takes into account the drop that occurs during defrost operation.
- The air flow rate and bypass factor are mentioned in the table.

- The rated power input for each model is mentioned in the table below.

### Pair

Pair	FCQHG100F	FCQG100F	FBQ100C	FHQG100C	FAQ100C	FVQ100C	FHQ100CA	FUQ100C	FBQ100D
AFR (BF)	32,3 (0.17)	32,0 (0.17)	32,0 (0.13)	20,0 (0.09)	26,0 (0.10)	28,0 (0.20)	28,0 (0.09)	31,0 (0.20)	29,0 (0.03)

### Pair

	FCQHG100F	FCQG100F	FBQ100C	FHQG100C	FAQ100C	FVQ100C	FHQ100CA	FUQ100C	FBQ100D
Cooling	2,15	2,45	2,44	2,49	2,63	2,49	2,49	2,33	2,49
Heating	2,16	2,60	2,57	2,60	3,00	2,61	2,60	2,62	2,45

### Twin

	FCQG50F X 2	FBQ50C X 2	FHQ50CA X 2	FFQ50C X 2	FDX50F X 2	FBQ50D X 2	FNQ50A X 2
AFR (BF)	12,6 x 2 (0.22 x 2)	16 x 2 (0.16 x 2)	15 x 2 (0.18 x 2)	12 x 2 (0.16 x 2)	12:C/16:H (0.11 x 2)	15 x 3 (0.13 x 2)	12:C/16:H (0.11 x 2)

### Twin

	FCQG50F X 2	FBQ50C X 2	FHQ50CA X 2	FFQ50C X 2	FDX50F X 2	FBQ50D X 2	FNQ50A X 2
Cooling	2,32	2,51	2,93	2,65	2,51	2,87	2,51
Heating	2,46	2,86	3,28	2,89	2,96	2,73	2,96

### Triple

	FCQG35F X 3	FBQ35C X 3	FHQ35CA X 3	FFQ35C X 3	FDX35F X 3	FBQ35D X 3	FNQ35A X 3
AFR (BF)	12,5 x 3 (0.4 x 3)	16 x 3 (0.15 x 3)	14 x 3 (0.17 x 3)	10 x 3 (0.25 x 3)	8,7 x 3 (0.17 x 3)	15 x 3 (0.08 x 3)	8,7 x 3 (0.17 x 3)

### Triple

	FCQG35F X 3	FBQ35C X 3	FHQ35CA X 3	FFQ35C X 3	FDX35F X 3	FBQ35D X 3	FNQ35A X 3
Cooling	2,38	2,51	2,91	2,45	2,81	2,68	2,81
Heating	2,51	2,86	3,20	2,59	3,68	2,70	3,68