



RZQG71L9V1
RZQG71L8Y1

Cooling

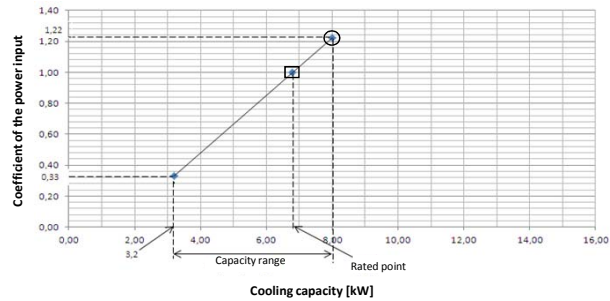

Heating

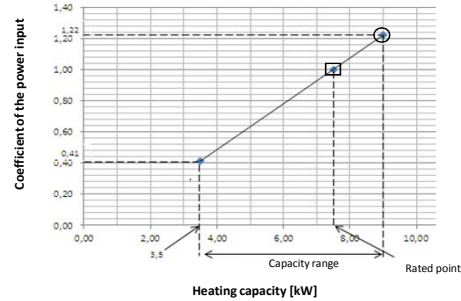

Symbols

- AFR: Air flow rate [m³/min]
 - BF: Bypass factor
 - EWB: Entering wet-bulb temperature (°C WB)
 - EDB: Entering dry-bulb temperature (°C DB)
 - TC: Maximum total cooling/heating capacity [kW]
 - SHC: Sensible heat capacity [kW]
 - CPI: Coefficient of the power input
 - PI: Power input [kW]
- compressor + indoor and outdoor fan motors

Cooling

Indoor		Outdoor temperature [°C DB]											
		25			30			35			40		
°CWB	°CDB	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI
16,0	22	8,03	5,45	1,00	7,76	5,32	1,11	7,48	5,20	1,21	7,21	5,06	1,32
18,0	25	8,40	5,45	1,00	8,11	5,32	1,11	7,83	5,19	1,22	7,54	5,05	1,33
19,0	27	8,59	5,44	1,01	8,30	5,32	1,12	8,00	5,18	1,22	7,70	5,05	1,33
19,5	27	8,68	5,43	1,01	8,39	5,31	1,12	8,09	5,17	1,22	7,79	5,05	1,33
22,0	30	9,15	5,38	1,01	8,84	5,25	1,12	8,52	5,13	1,23	8,21	4,99	1,34
24,0	32	9,53	5,31	1,03	9,20	5,19	1,13	8,87	5,06	1,25	8,54	4,92	1,35

Heating

Indoor		Outdoor temperature [°C DB]											
		-15,0		-10,0		-5,0		0,0		6,0		10,0	
°CWB	°CDB	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI
16	6,44	0,93	7,09	0,99	7,55	1,02	7,79	1,06	9,00	1,12	9,71	1,19	1,24
18	6,43	0,98	7,08	1,03	7,54	1,07	7,78	1,10	9,00	1,17	9,71	1,24	1,28
20	6,42	1,01	7,07	1,07	7,53	1,12	7,77	1,14	9,00	1,22	9,71	1,28	1,31
21	6,42	1,03	7,07	1,09	7,53	1,13	7,77	1,16	9,00	1,24	9,71	1,31	1,33
22	6,42	1,05	7,06	1,11	7,52	1,15	7,76	1,19	9,00	1,27	9,71	1,33	1,38
24	6,41	1,09	7,05	1,15	7,51	1,20	7,75	1,23	9,00	1,32	9,67	1,38	1,43

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- = Maximum at standard conditions
□ = Rated capacity and rated coefficient of the power input
The maximum capacity is not guaranteed except at standard conditions.
- SHC is based on indoor units EWB & EDB.
SHC for other dry-bulb temperatures = SHC + SHC*
SHC* = SHC correction for other dry-bulb temperatures
= 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
- The capacities are based on the following conditions:
Outdoor air: 85% RH
However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
Corresponding refrigerant piping length: 5.0 m
Level difference: 0m
- CPI is a percentage value compared to the rated value which is 1.00.
- The error rate for this value is less than 5% and depends on the indoor unit type.
- The heating performance takes into account the drop that occurs during defrost operation.
- The air flow rate and bypass factor are mentioned in the table.

- The rated power input for each model is mentioned in the table below.

Pair

	FCQH71F	FCQG71F	FBQ71C	FHQG71C	FAQ71C	FVQ71C	FHQ71CA	FUQ71C	FBQ71D
AFR	21,2	21,5	18,0	20,5	18,0	18,0	20,5	23,0	18,0
(BF)	(0,2)	(0,14)	(0,08)	(0,13)	(0,16)	(0,16)	(0,13)	(0,24)	(0,13)

Pair

	FCQH71F	FCQG71F	FBQ71C	FHQG71C	FAQ71C	FVQ71C	FHQ71CA	FUQ71C	FBQ71D
Cooling	1,66	2,01	1,94	1,78	2,00	2,02	1,78	1,67	1,89
Heating	1,56	1,89	2,05	1,82	2,03	2,06	1,82	1,68	1,87

Twin

	FCQG35F X 2	FBQ35C X 2	FHQ35CA X 2	FFQ35C X 2	FDXS35F X 2	FBQ35D X 2	FNQ35A X 2
AFR	12,5 x 2	16 x 2	14 x 2	10 x 2	8,7 x 2	15 x 2	8,7 x 2
(BF)	(0,4 x 2)	(0,15 x 2)	(0,17 x 2)	(0,25 x 2)	(0,17 x 2)	(0,08 x 2)	(0,17 x 2)

Twin

	FCQG35F X 2	FBQ35C X 2	FHQ35CA X 2	FFQ35C X 2	FDXS35F X 2	FBQ35D X 2	FNQ35A X 2
Cooling	2,04	1,98	2,34	2,02	2,23	2,01	2,23
Heating	1,92	2,16	2,70	1,88	2,55	2,08	2,55