



Cooling

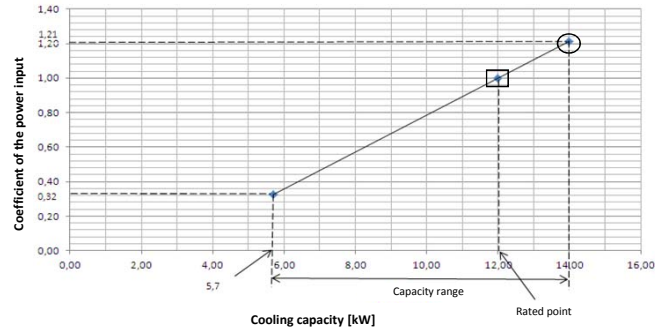

Heating

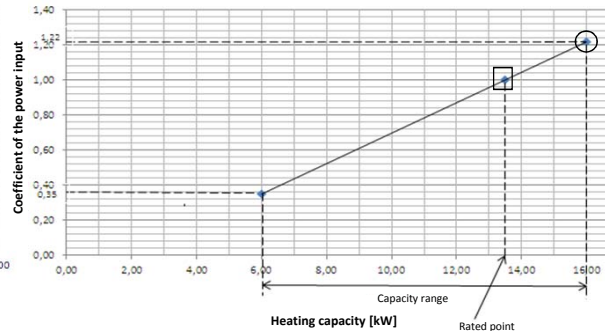

- Symbols**
- AFR: Air flow rate [m³/min]
 - BF: Bypass factor
 - EWB: Entering wet-bulb temperature (°C WB)
 - EDB: Entering dry-bulb temperature (°C DB)
 - TC: Maximum total cooling/heating capacity [kW]
 - SHC: Sensible heat capacity [kW]
 - CPI: Coefficient of the power input
 - PI: Power input [kW]
- compressor + indoor and outdoor fan motors

Cooling

Indoor		Outdoor temperature [°C DB]											
		25			30			35			40		
°CWB	°CDB	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI	TC	SHC	CPI
16,0	22	14,1	9,54	0,99	13,6	9,30	1,09	13,1	9,12	1,19	12,6	8,78	1,29
18,0	25	14,7	9,50	0,99	14,2	9,32	1,09	13,7	9,09	1,20	13,2	8,83	1,31
19,5	27	15,0	9,52	1,00	14,5	9,34	1,10	14,0	9,06	1,20	13,5	8,87	1,31
19,5	27	15,2	9,52	1,00	14,7	9,26	1,11	14,2	9,08	1,20	13,6	8,81	1,31
22,0	30	16,0	9,39	1,00	15,5	9,14	1,11	14,9	8,95	1,21	14,4	8,74	1,32
24,0	32	16,7	9,31	1,01	16,1	9,09	1,12	15,5	8,83	1,23	15,0	8,63	1,33

Heating

Indoor		Outdoor temperature [°C WB]											
		-15,0		-10,0		-5,0		0,0		6,0		10,0	
°CDB	°CWB	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI	TC	CPI
16	10,7	0,93	1,18	0,99	1,26	1,02	1,30	1,05	1,60	1,12	1,73	1,18	1,28
18	10,7	0,97	1,18	1,02	1,25	1,07	1,29	1,10	1,60	1,17	1,73	1,28	1,28
20	10,7	1,01	1,18	1,07	1,25	1,11	1,29	1,14	16,0	1,22	1,73	1,28	1,28
21	10,7	1,03	1,18	1,09	1,25	1,13	1,29	1,16	16,0	1,24	1,73	1,31	1,31
22	10,7	1,04	1,18	1,10	1,25	1,14	1,29	1,18	16,0	1,27	1,73	1,33	1,33
24	10,7	1,09	1,18	1,15	1,25	1,19	1,29	1,23	16,0	1,31	1,73	1,38	1,38

Notes

- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
- = Maximum at standard conditions
 - = Rated capacity and rated coefficient of the power input

The maximum capacity is not guaranteed except at standard conditions.
- SHC is based on indoor units EWB & EDB.
SHC for other dry-bulb temperatures = SHC + SHC*
SHC* = SHC correction for other dry-bulb temperatures
= 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
- The capacities are based on the following conditions:
Outdoor air: 85% RH
However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
Corresponding refrigerant piping length: 5.0 m
Level difference: 0m
- CPI is a percentage value compared to the rated value which is 1.00.
- The error rate for this value is less than 5% and depends on the indoor unit type.
- The heating performance takes into account the drop that occurs during defrost operation.
- The air flow rate and bypass factor are mentioned in the table.

- The rated power input for each model is mentioned in the table below.

Pair

	FCQG125F	FCQ125F	FBQ125C	FHQ125C	FAQ125C	FVQ125C	FHQ125CA	FBQ125D
AFR	33,5	33,0	39,0	31,0	39,0	28,0	31,0	34,0
(BF)	(0.19)	(0.21)	(0.16)	(0.134)	(0.16)	(0.16)	(0.14)	(0.06)

Pair

	FCQG125F	FCQ125F	FBQ125C	FHQ125C	FAQ125C	FVQ125C	FHQ125CA	FBQ125D
Cooling	3,71	3,74	3,74	4,15	3,74	4,27	4,15	3,72
Heating	3,60	3,96	3,85	3,73	3,85	3,96	3,73	3,72

Twin

	FCQG60F X 2	FBQ60C X 2	FHQ60CA X 2	FFQ60C X 2	FDXS60F X 2	FBQ60D X 2	FNQ60A X 2
AFR	13,6 x 2	18 x 2	19,5 x 2	14,5 x 2	16 x 2	18 x 2	16 x 2
(BF)	(0.2 x 2)	(0.15 x 2)	(0.20 x 2)	(0.11 x 2)	(0.12 x 2)	(0.15 x 2)	(0.12 x 2)

Twin

	FCQG60F X 2	FBQ60C X 2	FHQ60CA X 2	FFQ60C X 2	FDXS60F X 2	FBQ60D X 2	FNQ60A X 2
Cooling	3,66	3,95	4,34	4,75	4,88	4,24	4,88
Heating	3,88	4,06	4,43	4,33	4,38	4,14	4,38

Triple

	FCQG50F X 3	FBQ50C X 3	FHQ50CA X 3	FFQ50C X 3	FDXS50F X 3	FBQ50D X 3	FNQ50A X 3
AFR	12,6 x 3	16 x 3	15 x 3	12 x 3	12:C/16:H	15 x 3	12:C/16:H
(BF)	(0.22 x 3)	(0.16 x 3)	(0.18 x 3)	(0.16 x 3)	(0.11 x 3)	(0.13 x 3)	(0.11 x 3)

Triple

	FCQG50F X 3	FBQ50C X 3	FHQ50CA X 3	FFQ50C X 3	FDXS50F X 3	FBQ50D X 3	FNQ50A X 3
Cooling	3,69	3,95	4,33	4,14	4,07	4,08	4,07
Heating	3,90	4,06	4,42	3,87	3,92	4,09	3,92

Double twin

	FCQG35F X 4	FBQ35C X 4	FHQ35CA X 4	FFQ35C X 4	FDXS35F X 4	FBQ35D X 4	FNQ35A X 4
AFR	12,5 x 4	16 x 4	14 x 4	10 x 4	8,7 x 4	15 x 4	8,7 x 4
(BF)	(0.4 x 4)	(0.15 x 4)	(0.17 x 4)	(0.25 x 4)	(0.17 x 4)	(0.08 x 4)	(0.17 x 4)

Double twin

	FCQG35F X 4	FBQ35C X 4	FHQ35CA X 4	FFQ35C X 4	FDXS35F X 4	FBQ35D X 4	FNQ35A X 4
Cooling	3,75	3,95	4,31	3,99	4,67	3,95	4,67
Heating	3,96	4,06	4,32	3,59	4,66	4,03	4,66