




Cooling

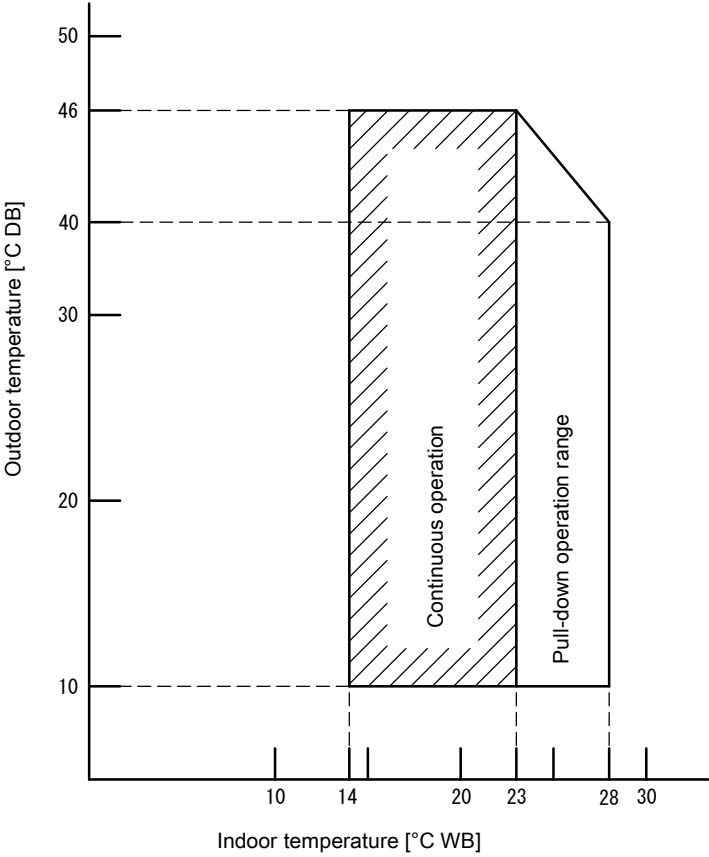

Cooling

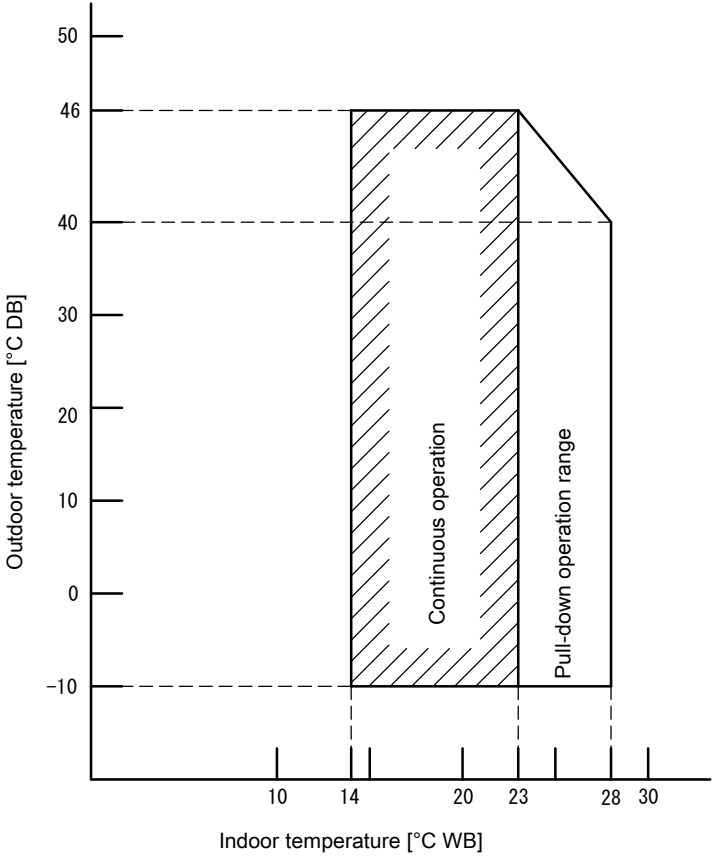

Heating

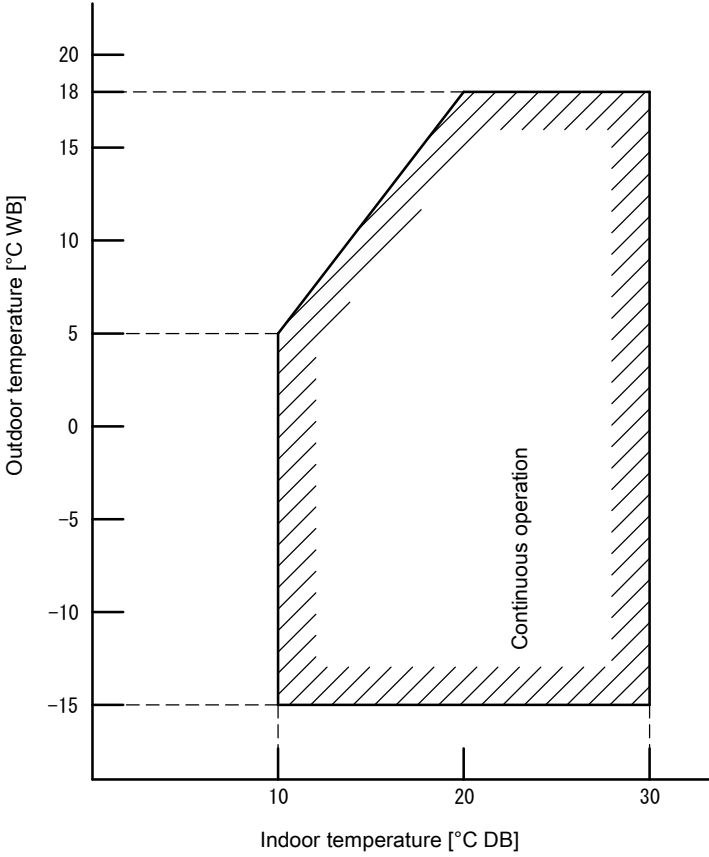

Notes

- 1. The graphs is based on the following conditions.
 - Corresponding refrigerant piping length: 5 m
 - Level difference: 0m
 - Air flow rate High
- 2. Editable data for this drawing are available in the GDE (E-BOM) system.