



ARXQ-A RXQ-A

Cooling

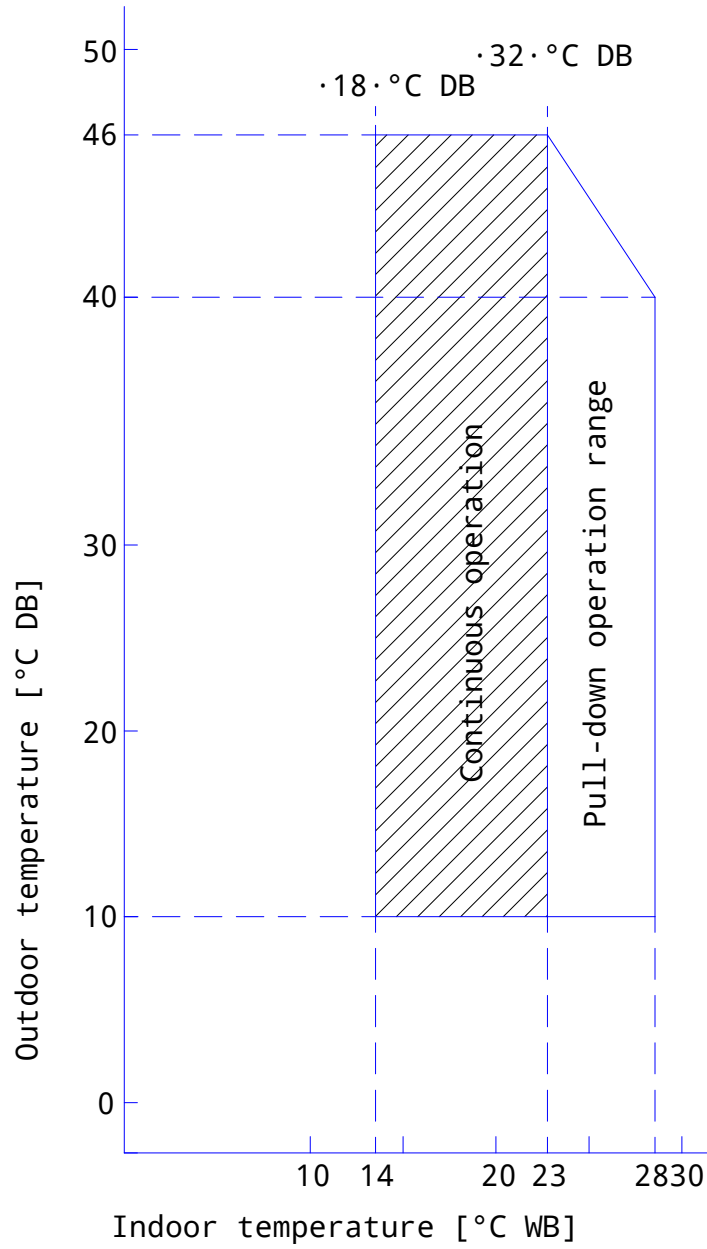

Heating

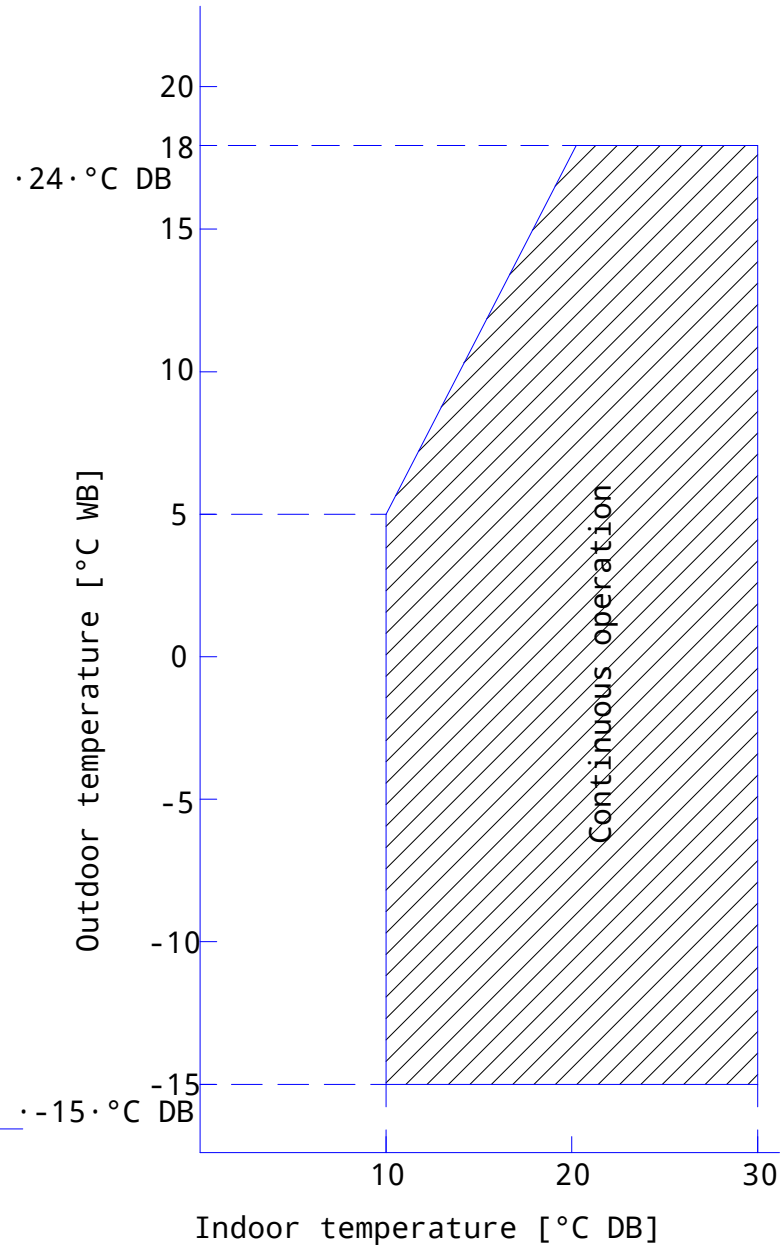

Notes

- Data is valid under the following conditions
 Corresponding refrigerant piping length: $\cdot 5 \cdot \text{m}$
 Level difference: $\cdot 0 \cdot \text{m}$
 Air flow rate High