



ATXC50D / FTXC50D

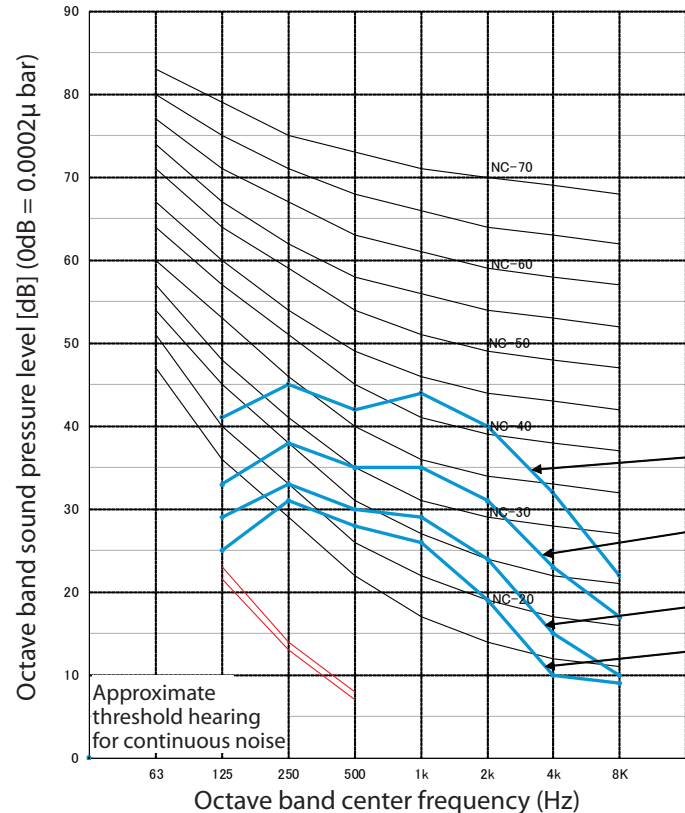

High (H)
 Medium (M)
 Low (L)
 Silent (SL)

NOTES

1. Measuring place
 Anechoic chamber
 Operation noise differs with operation and ambient conditions.
2. Operating conditions
 Power source: 220-240V 50Hz
3. Location of microphone.

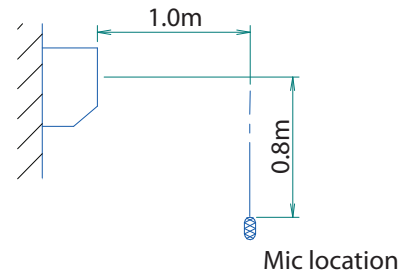

Testing Data Input								Overall (dBA)	Noise criteria
Fan speed	125	250	500	1k	2k	4k	8k		
H	41	45	42	44	40	32	22	47	43
M	33	38	35	35	31	23	17	39	34
L	29	33	30	29	24	15	10	33	28
SL	25	31	28	26	19	10	9	30	24