



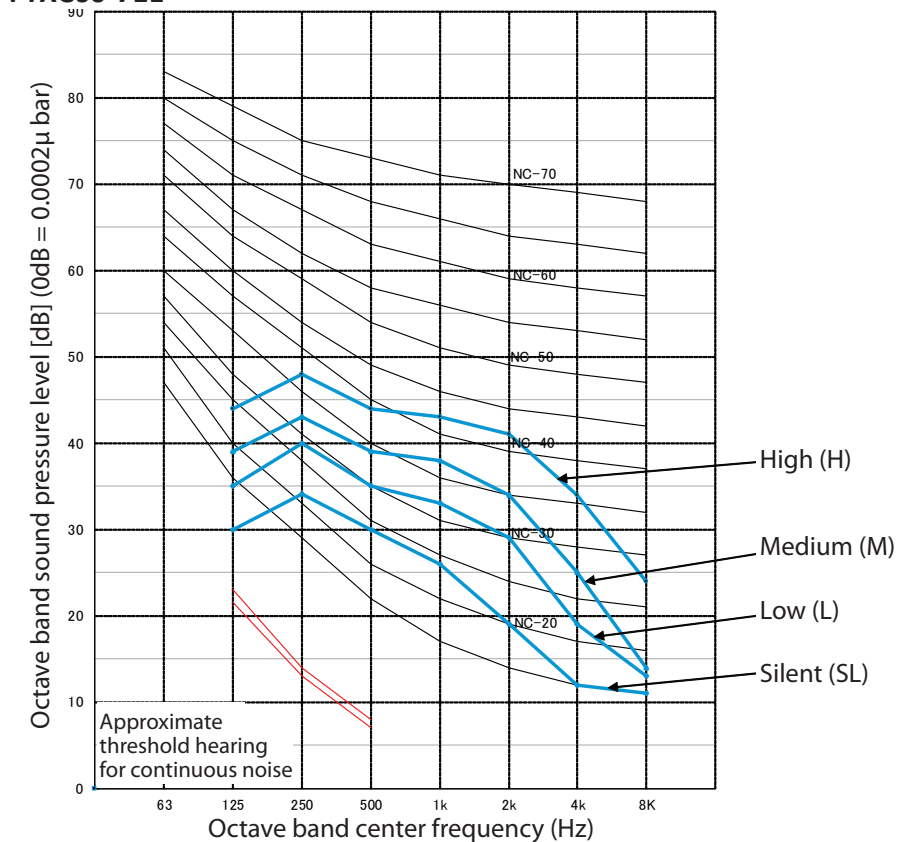

NOTES

1. Measuring place
Anechoic chamber
Operation noise differs with operation and ambient conditions.
2. Operating conditions
Power source: 220-240V 50Hz
3. Location of microphone.

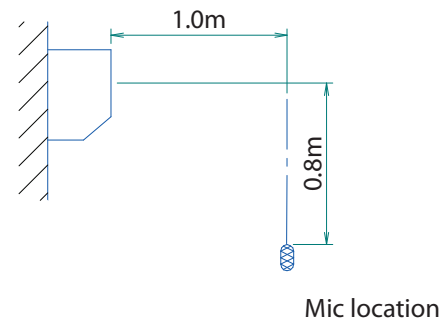

Testing Data Input								Overall (dBA)	Noise criteria
Fan speed	125	250	500	1k	2k	4k	8k		
H	44	48	44	43	41	34	24	48	42
M	39	43	39	38	34	25	14	42	37
L	35	40	35	33	29	19	13	38	32
SL	30	34	30	26	19	12	11	31	24