
ARXS50G2 Cooling

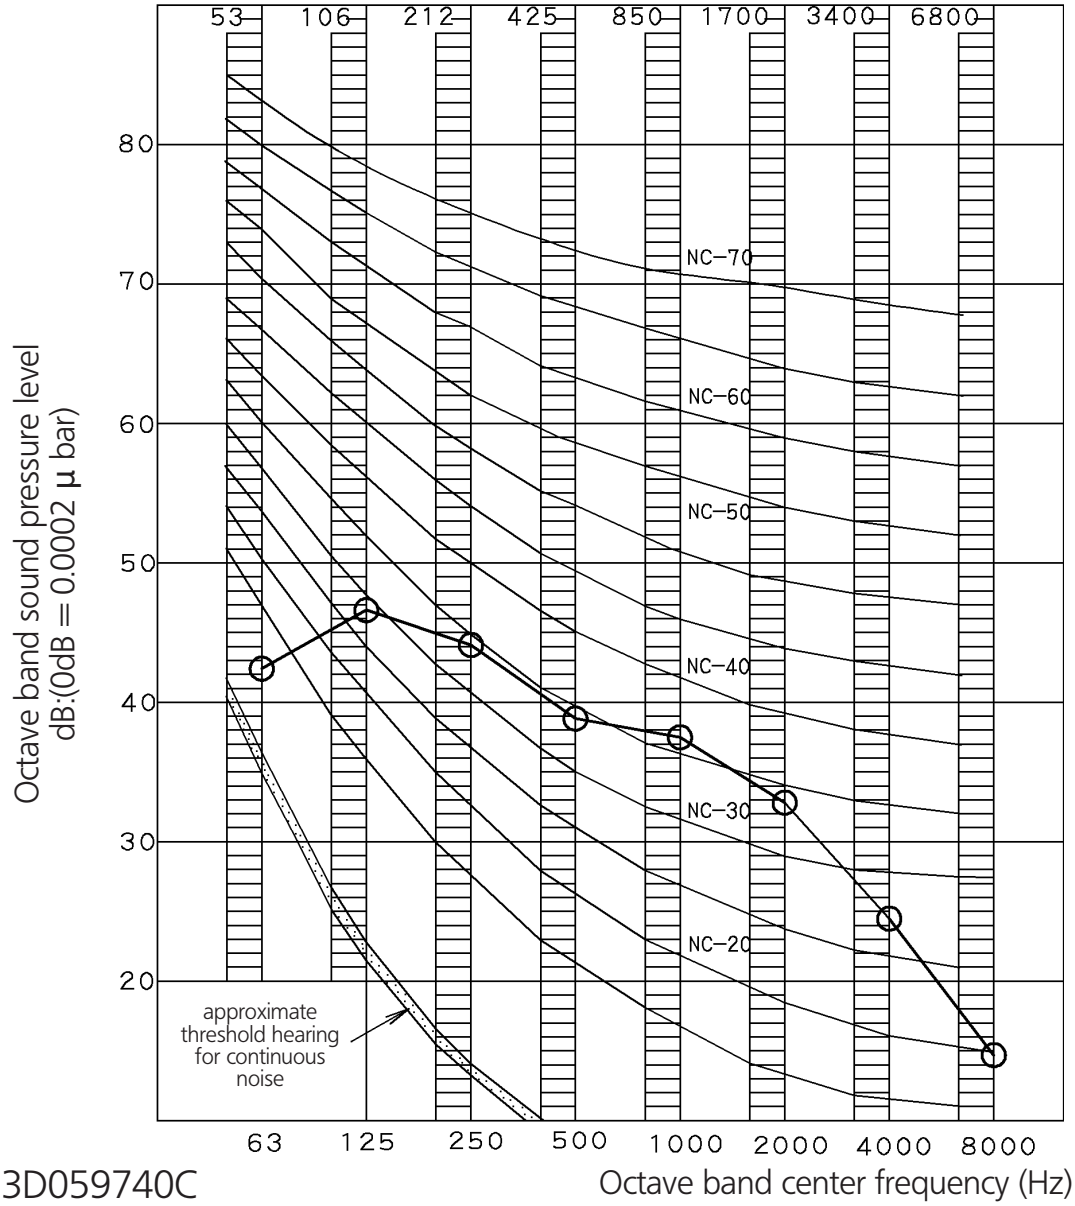

3D059740C

Overall (dB)

Scale	50Hz 220~240v (H)
A	48

(B,G,N is already rectified)

Measuring place

Measure in anechoic room

Operating conditions

Power source 220~240V 50Hz

50Hz 220-240V

Cooling

Location of microphone

The operation noise measuring method is in accordance with JISC9612

Note:
Operation noise differs with operation and ambient conditions.