



FDEQ71-100B

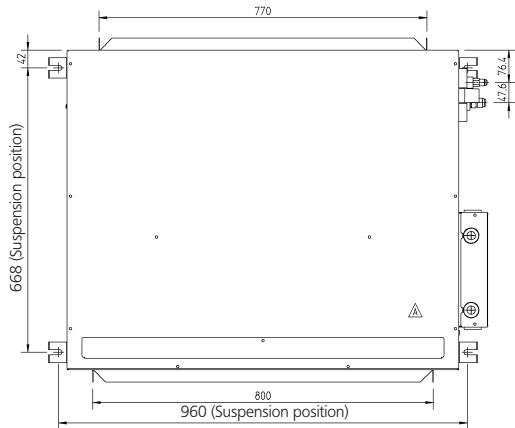


view A

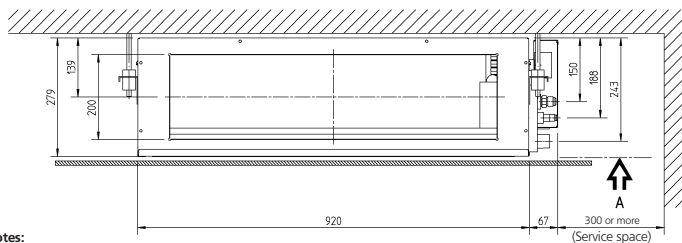

Notes:

1. Refer to 'outlook drawing for installing optional accessories' when installing optional accessories.
2. For maintenance of the air filter, it is necessary to provide a service access panel according to the installation method. (Refer to the 'filter installation method' drawing)

- 1 Liquid pipe connection ϕ 9.52 Flare connection
- 2 Gas pipe connection ϕ 15.90 Flare connection
- 3 Remote control wiring connection
- 4 Power supply connection
- 5 Drain pipe connection VP25 (O.D. ϕ 32, I.D. ϕ 25)
- 6 Air filter
- 7 Air suction side
- 8 Air discharge side
- 9 Name plate

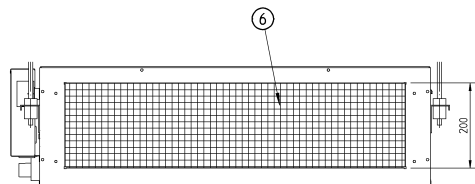

view B

