


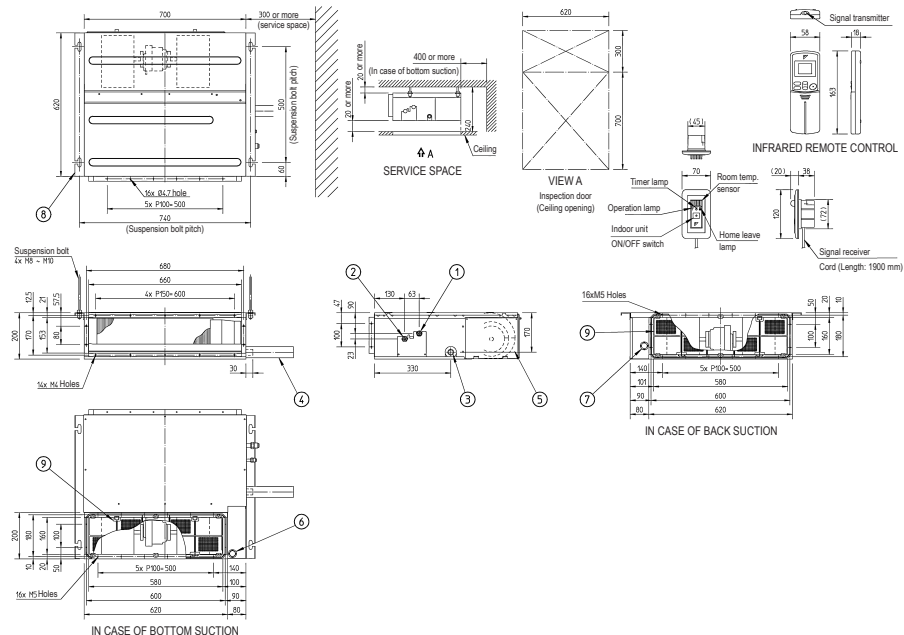

3TW32964-1

NOTES

- In case of back suction, mount chamber cover to bottom side of the unit.
In case of bottom suction, mount chamber cover to back side of the unit.
- Location of unit name plate: control box cover.
- Mount the air filter at the suction side. (Use an air filter whose dust collecting efficiency is at least 50% in a gravimetric technique). It can not be equipped with air filter (accessory) when connecting duct to suction side.

Item	Name	Description
1	Liquid pipe connection	Ø6.4 Flare connection
2	Gas pipe connection	Ø12.7 Flare connection
3	Socket for drain	VP20 (OD Ø26, ID Ø20)
4	Drain hose (accessory)	ID Ø25 (Outlet)
5	Control box	
6	Infrared receiver unit connection	
7	Power supply connection	
8	Suspension bracket	
9	Air filter (accessory)	