


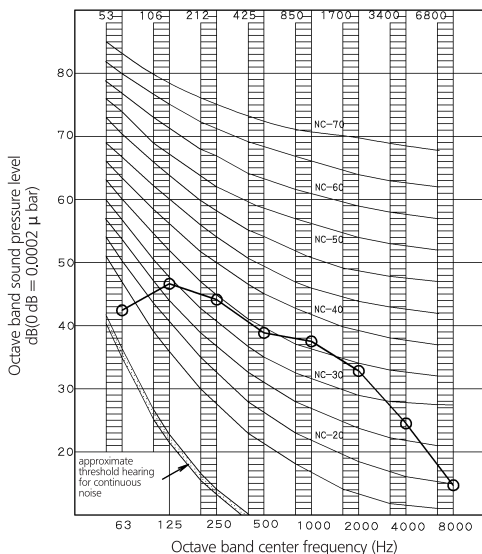

NOTES

1 Overall (dB)

Scale	50Hz 220-240V
A	48

(B,G,N is already rectified)

2 Measuring place: Measured in an anechoic room

3 Operation noise differs with operation and ambient conditions.

4 Operating conditions:

Power source 220-240V 50Hz


C—O 50Hz 220-240V

Cooling

5 Location of microphone

JIS C9612

The operation noise measuring method is in accordance with JIS C9612

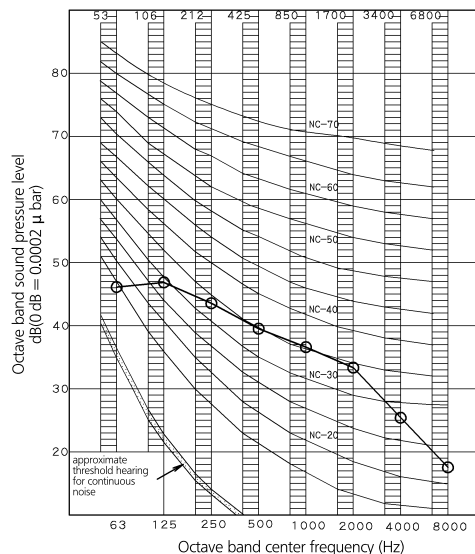

NOTES

1 Overall (dB)

Scale	50Hz 220-240V
A	48

(B,G,N is already rectified)

2 Measuring place: Measured in an anechoic room

3 Operation noise differs with operation and ambient conditions.

4 Operating conditions:

Power source 220-240V 50Hz

C—O 50Hz 220-240V

Heating

5 Location of microphone

JIS C9612

The operation noise measuring method is in accordance with JIS C9612