


RZQS125-140DV1 (Double twin)

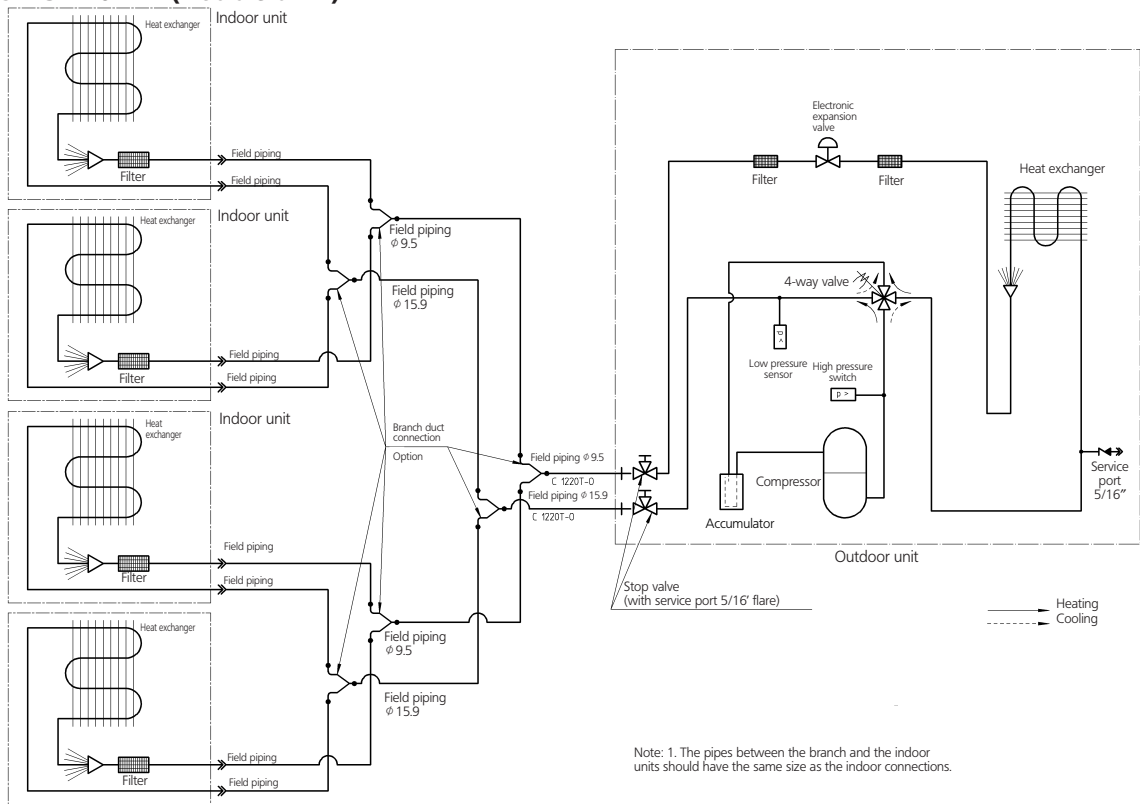

Note: 1. The pipes between the branch and the indoor units should have the same size as the indoor connections.

- ↔ Check valve
- ↔ Flare connection
- ⋈ Screw connection
- ⋈ Flange connection
- ✕ Pinched pipe
- Spinned pipe