


RZQS71-140DV1 (Twin)

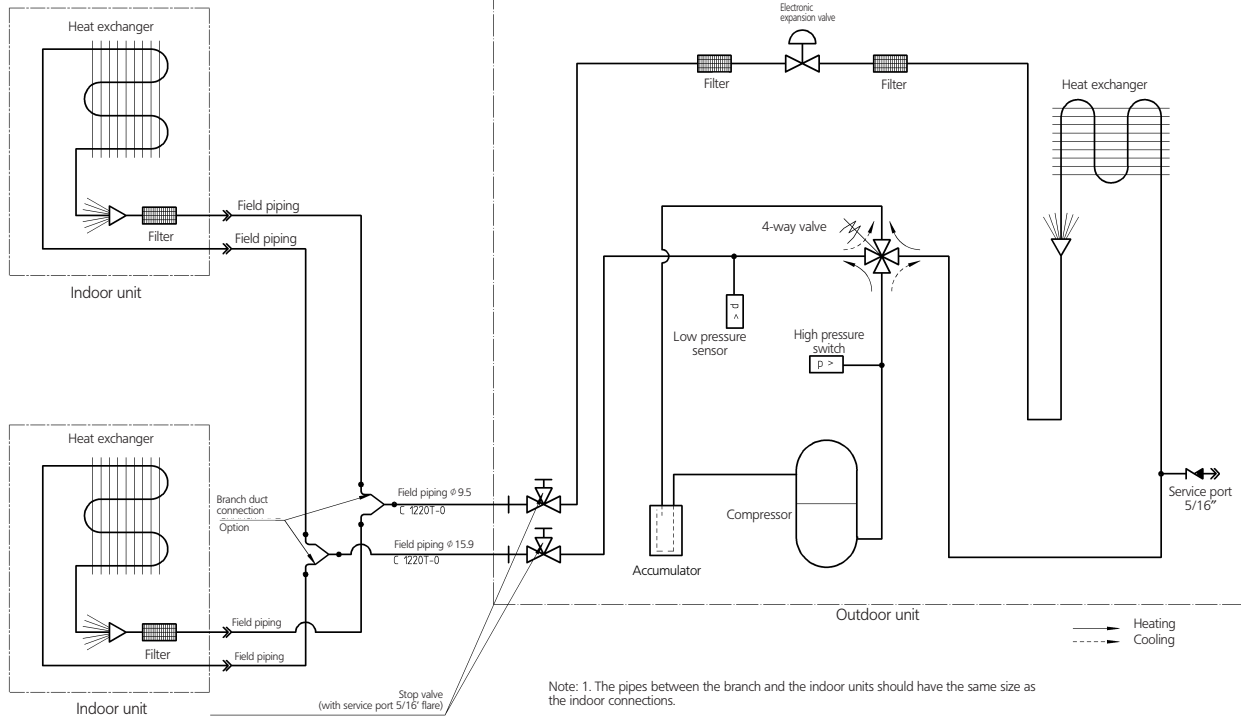

Note: 1. The pipes between the branch and the indoor units should have the same size as the indoor connections.