



Cooling

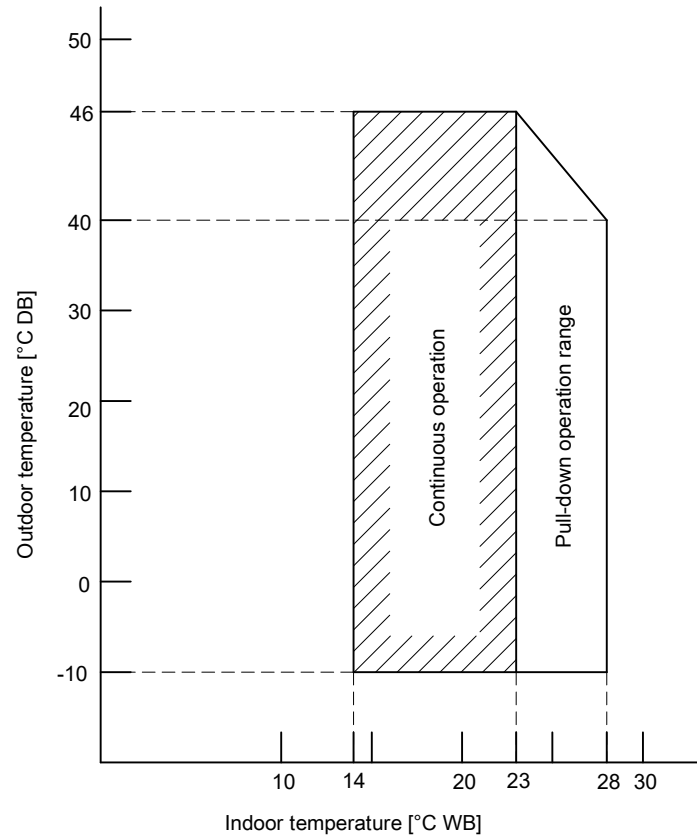

Heating

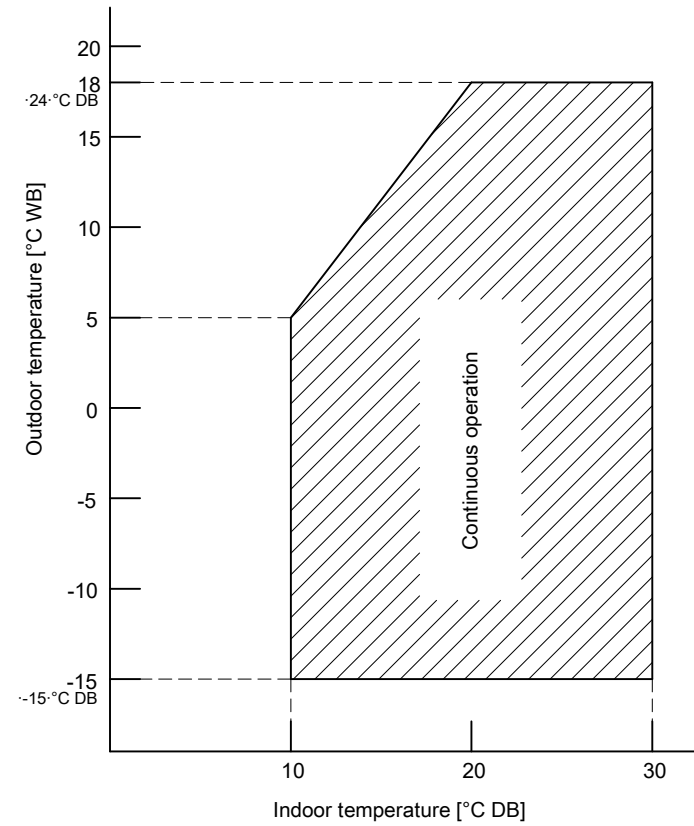

Notes

- The graphs are based on the following conditions.
 Corresponding refrigerant piping length: 5 m
 Level difference: 0 m
 Air flow rate High
- Editable data for this drawing are available in the GDE (E-BOM) system.